



October 2021

Monthly Operating Report





November 12, 2021

Mr. Keith Nastasia

Rockland Sewer Superintendent

587 Rear Summer Street

Rockland, MA 02370

RE: Rockland Wastewater Facility

Monthly Report—October 2021

Dear Mr. Nastasia,

Please see the enclosed October 2021 Monthly Operating Report (MOR) for the Suez Operations and Maintenance contract.

Please contact me at your convenience should you have any questions regarding this report.

Sincerely,

Rick Kotouch

SUEZ Project Manager

CC: Charles Heshion

Dan Duross

OCTOBER 2021 MONTHLY OPERATING REPORT

1. SUMMARY:

- 1) The facility will be reporting **1** exceedance for the month of October 2021.
 - 1) Monthly Average flow was reported as **3.190** MGD, NPDES limit is 2.5 MGD
- 2) There were no lost time / first aid injuries throughout the month
- 3) The facility treated a total of **98.885** Million Gallons.
- 4) The total rainfall for this reporting period was **7.56"**
- 5) I&I Work is ongoing
- 6) **170** work orders were closed in October, with **10** as corrective maintenance work orders, **3** of the 10 were emergency call outs, while **0** were related to the collection system.
- 7) New permit still pending from EPA

2. STAFFING:

Current Employee Licenses as of 2/1/2021										
Employee	Title	Hoisting		Wastewater			NEWEA Collections			NEWEA Laboratory
		1C Forklift	1B Boom Truck & Forklift	4M	5C	7C	I	II	IV	I
Rick Kotouch	Project Manager					X			X	
Edwin McAuliffe	Asst. Project Manager		X			X		X		X
Steven Butts	Lab Technician					X				X
Chuck Amaral	Maintenance Foreman		X		X			X		
Megan Kelly Lynch	Operator	X				X				
Shaun Chaponis (Part Time Weekends)	Operator				X		X			
Garry Murrill	Operator				X			X		
Dan Sullivan-Xenos	Operator				X					
Kevin Fennell	Operator In Training									

3. EMPLOYEE HEALTH AND SAFETY:

Throughout the COVID-19 (Coronavirus) pandemic in an attempt to continue to serve the Town of Rockland with reliable operations and protect the staff of the Rockland team, SUEZ has implemented numerous procedures to ensure continuity of the operations. As the COVID-19 Delta variant continues, SUEZ at the Rockland facility has upgraded to a Threat Level 2 guideline as follows:


All Suez employees, visitors, and contractors will use face covering indoors except when at their assigned seat or when eating or drinking. All unvaccinated employees must wear a KN/N-95 respirator based on a risk assessment.


Visitors are still recommended to call ahead to set up appointments for in person visits at the site. All contractors and sales personnel are still required to be screened before entering the premises and meet the Covid visitor guidelines.

4 FOWS AND LOADINGS:

4.0 FLOWS, PRECIPITATION, AND WEATHER

- The facility treated a total of **98.885** MG during the month. The daily average flow was **3.190** MGD. This was **1.525** MGD more than the previous October monthly average, which was recorded at **1.525** MGD. The highest **peak** flow was recorded on October 31 as **6.04** MGD. The lowest instantaneous flow was **1.210** MGD, recorded October 20.
- The highest daily flow was recorded on October 31 as **5.505** MGD. The lowest daily flow was recorded on October 22 as **2.320** MGD.
- A total of **7.56"** of precipitation was received at the facility. The highest single day precipitation total was recorded on October 26 as **2.14"**
- The coldest day was October 29 at **41°F**. The warmest day was October 13 at **77°F**.

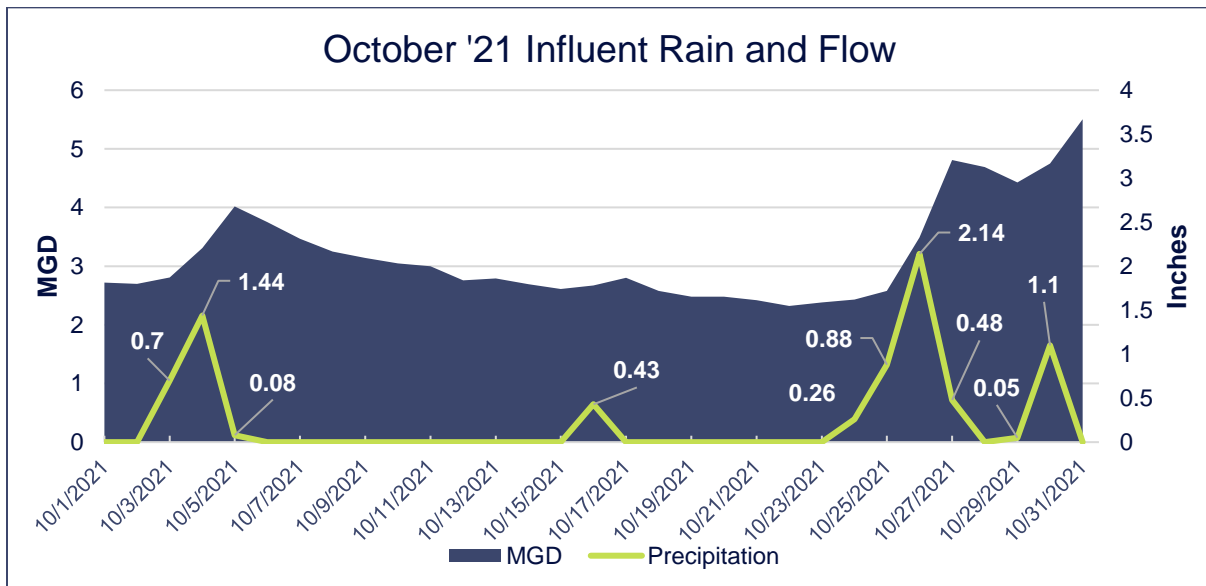

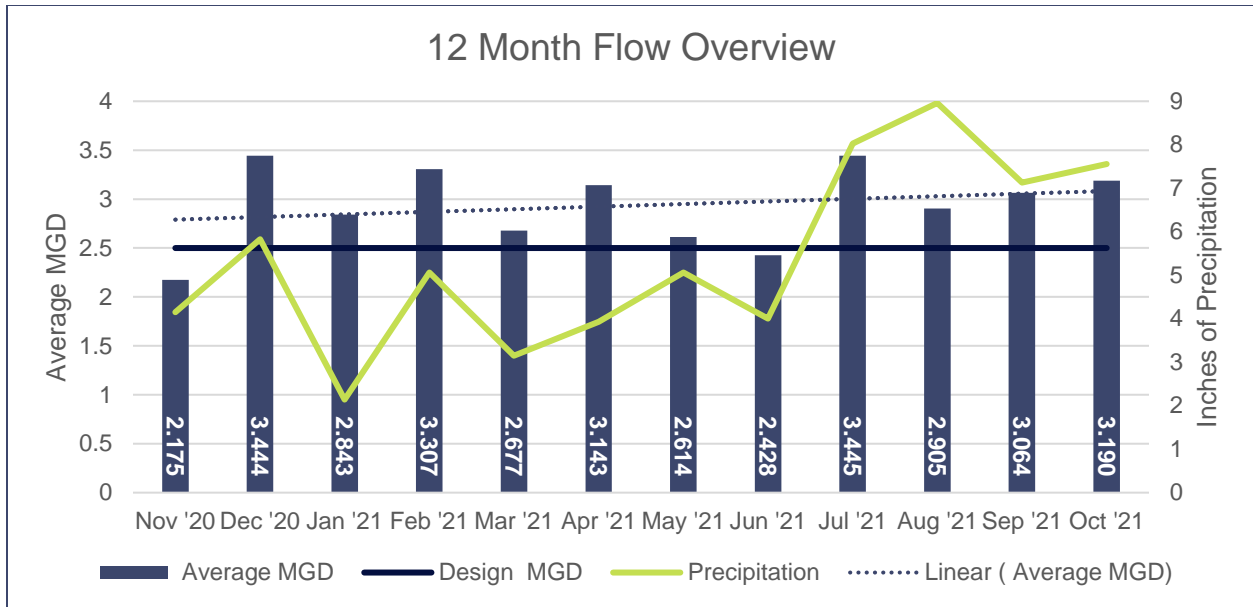


4.1 INFLUENT BOD AND TSS LOADINGS

ROCKLAND FLOW AND LOADINGS TRACKING						
Month/Yr	Inf. Flow	Inf BOD	Inf. TSS	Inf. Flow Mov. Avg.	Inf. BOD Mov. Avg.	Inf. TSS Mov. Avg.
	MGD	LBS	LBS	MGD	LBS	LBS
Nov '20	2.175	3,263	4,000	2.459	3,377	4,771
Dec '20	3.444	2,929	4,128	2.421	3,166	4,358
Jan '21	2.843	2,900	3,237	2.431	3,124	4,065
Feb '21	3.307	3,253	4,139	2.499	3,090	3,933
Mar '21	2.677	2,907	3,256	2.495	3,043	3,860
Apr '21	3.143	3,189	3,630	2.418	3,031	3,814
May '21	2.614	3,485	3,644	2.38	3,064	3,802
Jun '21	2.428	3,874	3,572	2.419	3,112	3,790
Jul '21	3.445	2,344	3,371	2.569	3,080	3,784
Aug '21	2.905	3,044	4,011	2.683	3,118	3,798
Sep '21	3.064	2,376	4,904	2.809	3,064	3,859
Oct '21	3.19	2,990	3,889	2.936	3,046	3,815

4.2 LIFT STATION FLOWS




The lift stations accounted for **10,475,281** gallons throughout the month, **10.6%** the total plant flow. Please note that monthly lift station flow totals are purely estimates based off of pump run hours and estimated flow rates. Values are not intended to in any way be used as design capacity volumes for potential future rehab / replacement projects.

Total Flows for October 2021		
Station	Total Gallons	% Off 12 Month Avg.
Millbrook	924,480	-12%
Summer	27,840	-6%
Market	475,500	-3%
John Burke	65,760	3%
Lincoln, Forest	1,598,100	21%
Wheeler	19,800	0%
Woodsbury	1,564,200	21%
OCW, HN, HS	5,779,601	-1%
Total:	10,475,281	3%

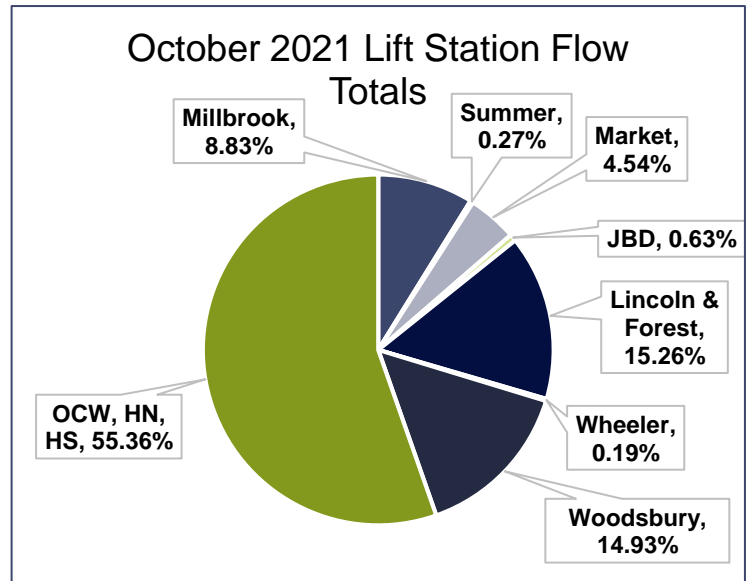

Lift Station Monthly Average Daily Flows (GPD)


Month	Millbrook	Sumer	Market	John Burke	Lincoln	Forrest	Wheeler	Woodsbury	Old Country Way	Hingham North	Hingham South
	GPD	GPD	GPD	GPD	GPD	GPD	GPD	GPD	GPD	GPD	GPD
Nov '20	35,208	1,080	13,850	1,840	2,080	32,270	768	36,180	51,800	124,920	143,280
Dec '20	35,316	984	14,900	1,992	1,580	37,660	714	46,140	62,300	136,440	219,240
Jan '21	41,688	952	15,050	2,024	1,540	37,800	726	46,380	60,130	136,800	211,680
Feb '21	34,272	832	15,250	2,016	2,100	41,440	684	44,880	59,850	148,500	188,640
Mar '21	37,656	1,024	15,700	1,928	2,260	41,650	738	45,540	58,800	148,500	183,960
Apr '21	34,020	984	17,450	2,064	2,280	41,580	762	51,720	63,770	160,920	205,560
May '21	33,876	968	16,950	1,880	2,160	37,590	678	36,060	59,220	152,640	184,320
June '21	34,272	1,000	16,400	2,112	5,020	46,410	708	33,720	51,240	153,360	172,080
July '21	33,166	952	17,226	2,183	4,684	54,126	732	36,813	68,894	199,974	227,845
Aug '21	30,345	968	16,887	2,563	2,826	53,042	761	44,594	62,797	169,839	190,568
Sept '21	30,348	968	17,000	2,560	2,840	52,990	768	44,700	63,070	170,460	191,160
Oct '21	29,822	898	15,339	2,121	3,252	51,552	639	50,458	65,303	163,568	187,084
Average	34,166	968	16,000	2,107	2,718	44,009	723	43,099	60,598	155,493	192,118

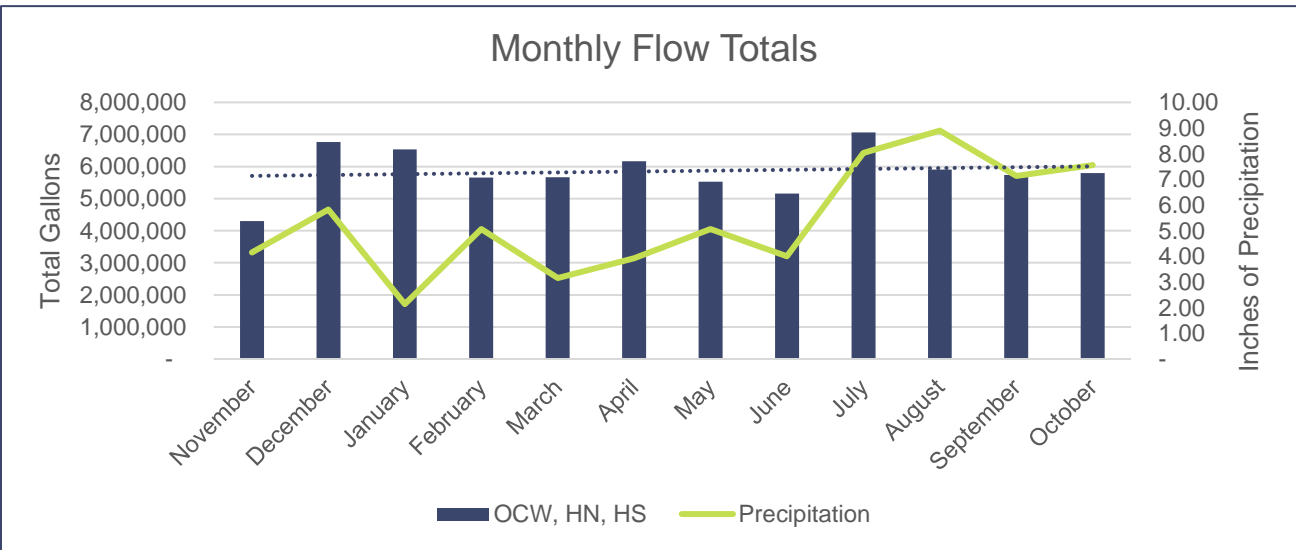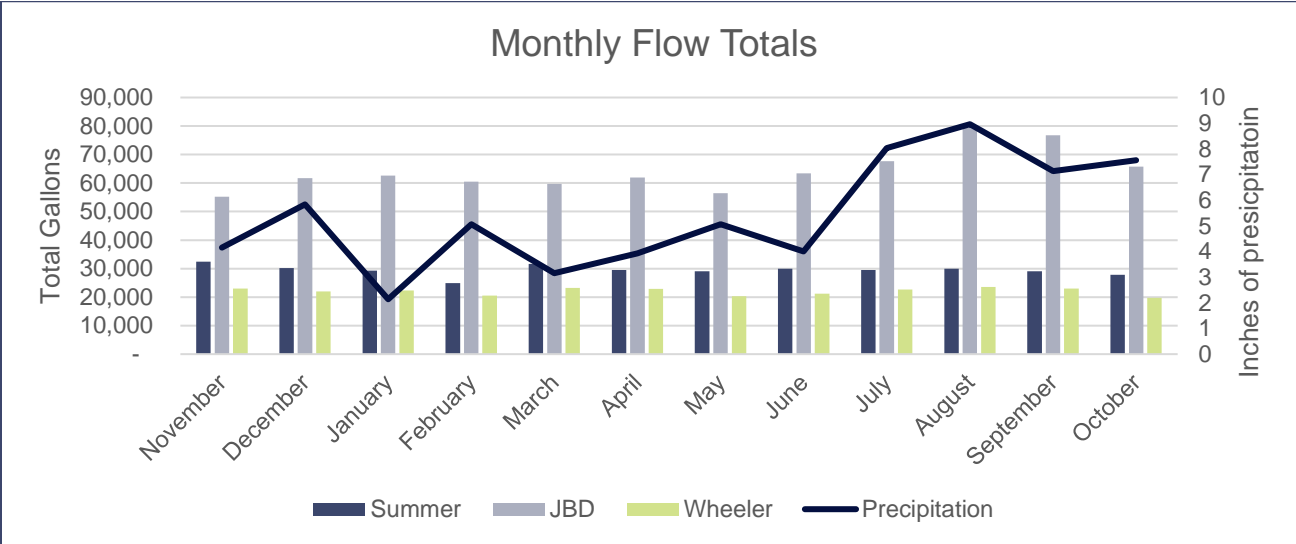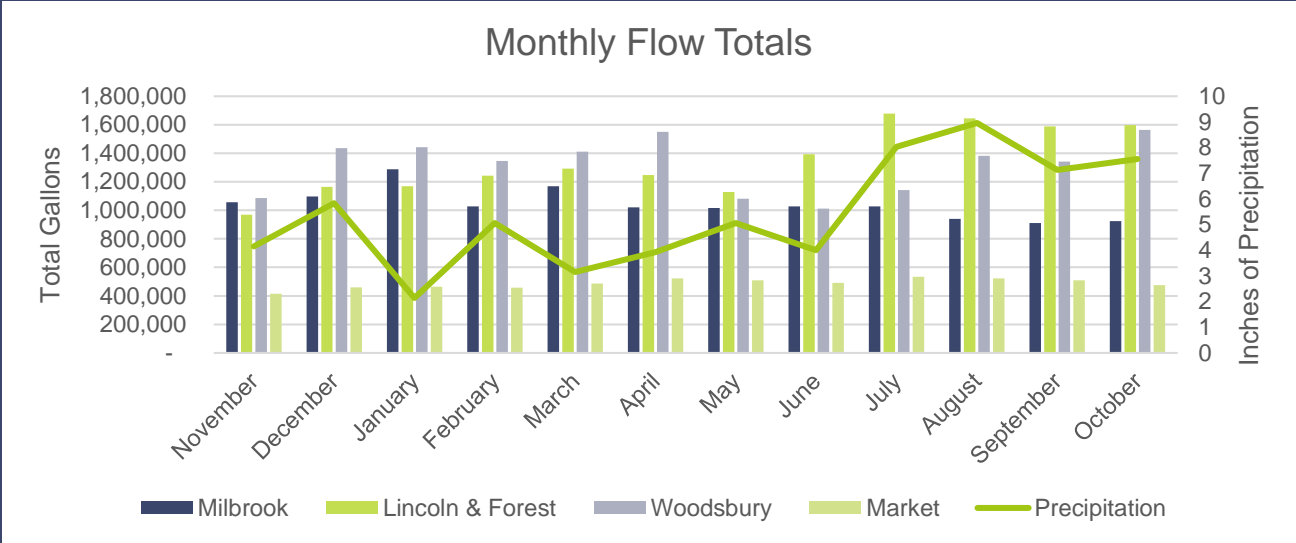

5.0 SOLIDS HANDLING

The BFP was operated a total of **108.5** hours this month and a total of **420,101** gallons were processed producing **118.9** Wet Tons of sludge that was hauled from the facility. The average BFP feed percent solids were **2.67%** and the BFP Cake average percent solids were **21.17%**. The digester feed to BFP differential was **94,973** gallons (overflow) for the month. The sludge processing Dry Tons conversion sheet is attached to this report.

Date	BFP Run Hours	Total Digester Feed	Total BFP Feed	Polymer Used	Actual Sludge Weight	Average Press Feed Total Solids	Average Cake Total Solids	Sludge Pick Up	Grit Removed
	HRS	Gal.	Gal.	Gal.	Wet Tons	%	%	Dumpster	Tons
Nov '20	149.8	468,303	556,363	124.0	120.6	3.24	21.62	6.00	
Dec '20	177.0	432,663	582,869	137.8	116.1	1.52	20.00	7.00	
Jan '21	129.0	468,846	421,221	103.2	106.6	2.44	19.27	5.00	
Feb '21	146.0	403,368	540,139	92.0	93.5	2.00	19.19	6.00	
Mar '21	190.3	560,191	600,688	142.4	152.4	2.08	19.16	7.00	
Apr '21	172.5	585,402	564,039	131.3	142.1	2.48	20.23	8.00	
May '21	161.5	504,683	470,321	108.0	124.6	2.62	21.62	7.00	
Jun '21	148.3	447,325	460,923	109.1	104.5	2.16	23.59	6.00	
Jul '21	129.3	536,074	495,343	90.4	113.3	2.33	21.29	7.00	
Aug '21	154.6	538,761	641,667	128.7	136.1	1.97	21.24	7.00	
Sep '21	154.3	459,723	594,127	133.0	129.2	1.75	21.08	6.00	4.00
Oct '21	108.5	515,074	420,101	86.6	118.9	2.67	21.17	5.00	
Annual Total	1,821	5,920,413	6,347,801	1,387	1,458	****	****	77	4.00
Avg.	152	493,368	528,983	116	122	2.27	20.79	6.4	****

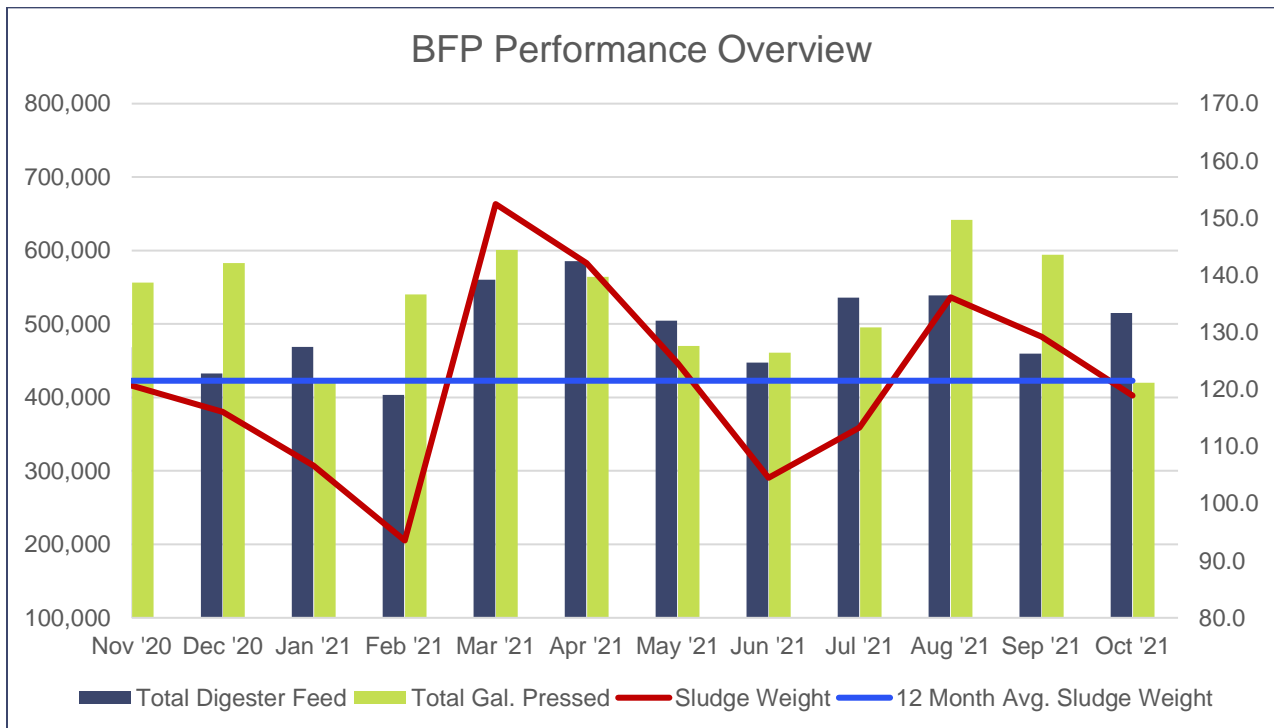

6.0 ENVIRONMENTAL COMPLIANCE

6.1 REGULATORY REPORTING

- EPA NETDMR submitted on the CDX website on 11/05/2021
- MADEP MOR mailed on 11/05/2021

6.2 NPDES COMPLIANCE

The facility will be reporting (1) exceedance for the month of October 2021

- 1) Monthly Average flow was reported as **3.190** MGD. NPDES limit is 2.5 MGD

Date	Plant Flow	BOD	BOD	TSS	TSS	NH3	Total P	Ph	Fecal Coliform	Aluminum	Copper	Dissolved Oxygen	Limits	Monthly Avg.	Weekly Avg.	Daily Max	
	MGD	Mg/L	Lbs./Day	Mg/L	Lbs./Day	Mg/L	Mg/L	Ph	CFU/100 ml	Ug/L	Ug/L	Mg/L					
Fri, Oct 01	2.720							7.32					BOD	Oct. 1 - April 30	20 Mg/L 417 lbs/day	20 Mg/L 417 lbs/Day	30 Mg/l 626 lbs/Day
Sat, Oct 02	2.700							7.23									
Sun, Oct 03	2.810							7.29	23								
Mon, Oct 04	3.310							7.33	68			TSS	May 1 - Sept. 30	6 Mg/L 125 lbs/Day	6 Mg/L 125 lbs/Day	10Mg/L 209 lbs/day	
Tue, Oct 05	4.020	2.0	67	3.0	101	0.20	0.17	7.22	81	7	6.7						
Wed, Oct 06	3.750							7.29									
Thu, Oct 07	3.470	2.0	58	3.3	96	0.20	0.19	7.19				NH3	Oct. 1 - Mar. 31	3.3 Mg/L	3.3 Mg/l	5.7 Mg/L	
Fri, Oct 08	3.250							7.08									
Sat, Oct 09	3.140							7.50									
Sun, Oct 10	3.050							7.70	156			Total Phosphorus	Apr. 1 - Oct. 31	0.2 Mg/L	*****	*****	
Mon, Oct 11	3.000							7.47	112								
Tue, Oct 12	2.760	2.0	46	2.0	46	0.20	0.19	7.30	136								
Wed, Oct 13	2.790							7.25				Ph	Apr. 1 - May 31	2.5 Mg/L	2.5 Mg/l	5.7 Mg/l	
Thu, Oct 14	2.690	3.0	67	3.7	83	0.20	0.15	7.19									
Fri, Oct 15	2.610							7.37									
Sat, Oct 16	2.670							7.43				Fecal	June 1 - Sept. 30	1.0 Mg/L	1.0 Mg/L	1.5 Mg/L	
Sun, Oct 17	2.800							7.46	126								
Mon, Oct 18	2.580							7.38	282								
Tue, Oct 19	2.480	2.0	41	6.0	124	0.20	0.11	7.33	210			Aluminum	Nov. 1 - Mar. 31	1.0 Mg/L	*****	*****	
Wed, Oct 20	2.480							7.32									
Thu, Oct 21	2.420	4.9	99	3.3	67	0.93	0.13	7.26									
Fri, Oct 22	2.320							7.28				Copper	*****	12 ug/l	*****	*****	
Sat, Oct 23	2.380							7.21									
Sun, Oct 24	2.430							7.38	27								
Mon, Oct 25	2.580							7.34	72			Dissolved Oxygen	May 1 - Sept. 30	> 7.4 mg/L	*****	*****	
Tue, Oct 26	3.490	3.0	87	3.3	96	0.20	0.26	7.24	95								
Wed, Oct 27	4.810							7.07									
Thu, Oct 28	4.690	2.0	78	3.0	117	0.20	0.22	6.99				Plant Flow	*****	*****	*****	2.5 MGD	
Fri, Oct 29	4.430							7.07									
Sat, Oct 30	4.750							7.28									
Sun, Oct 31	5.505							7.27	145			Daily Max	*****	*****	*****	*****	
Daily Max	5.505	4.90	98.90	6.00	124.10	0.93	0.26	7.70	282.00	*****	*****						*****
Daily Min.	2.320	*****	*****	*****	*****	*****	*****	6.99	*****	*****	*****						
Month Avg.	3.190	2.61	67.88	3.45	91.25	0.29	0.18	7.29	117.92	7	6.7	*****					

7.0 ENERGY CONSUMPTION

7.1 ELECTRICAL OVERVIEW



Due to billing cycle timing, all electrical data in the MOR will be one month behind. The following data is for electrical consumption during the **September 2021** operating period.

The department used a total of **122,323 KWH** for the month of Sept. 2021. Of this total, the lift stations accounted for **9.7%**, using **11,923 KWH**. The Main Plant accounted for the remaining **110,400 KWH**.

The KWH/ MG treated was **1,208** for the month, which is **21%** lower than the previous 12-month average of **1,522 KWH/MG**. The KWH/Lb. BOD Removed was **1.59 KWH/Lb.** for the month, which is **21%** higher than the previous 12-month average of **1.31 KWH/Lb.**

Monthly Energy Consumption										
Month	Plant Average Daily Flow (NO HFMP)	Plant Total Influent Flow	Plant KWH (Total Billed)	KWH/MG Treated (Plant)	Plant Lbs BOD Removed	KWH/Lb BOD Removed (Plant)	Off Peak Demand (Plant)	Peak Demand (Plant)	Total Lift Station KWH	Total KWH (Plant & Stations)
	MGD	MG	KWH	KWH/MG	Lbs	KWH/Lb	KW	KW	KWH	KWH
Oct '20	1.66	51.60	102,300	1,983	98,117	1.04	174	216	12,588	114,888
Nov '20	2.17	65.24	128,100	1,964	96,589	1.33	231	246	16,289	144,389
Dec '20	3.41	105.75	149,400	1,413	87,985	1.70	246	246	22,735	172,135
Jan '21	2.84	88.12	113,400	1,287	86,723	1.31	222	240	19,293	132,693
Feb '21	3.31	92.59	132,000	1,426	86,598	1.52	216	228	18,800	150,800
Mar '21	2.68	83.00	116,700	1,406	87,712	1.33	198	216	16,048	132,748
Apr '21	3.1	92.87	130,200	1,402	93,957	1.39	219	219	15,528	145,728
May '21	2.61	81.02	99,000	1,222	106,715	0.93	186	189	12,161	111,161
Jun '21	2.43	72.83	111,600	1,532	114,694	0.97	219	228	12,858	124,458
July '21	3.43	106.47	125,400	1,178	70,944	1.77	222	249	13,555	138,955
Aug '21	2.91	90.06	132,600	1,472	92,787	1.43	249	255	13,316	145,916
Sep '21	3.05	91.41	110,400	1,208	69,519	1.59	204	231	11,923	122,323
Average	2.80	85.08	120,925	1,458	91,028	1.36	216	230	15,425	136,350

Monthly Lift Station KWH														
Month	Hingham North	Hingham South	Spruce	Butternut	Old Country Way	Market	Woodsbury	Lincoln	Forest	Wheeler	Summer	Milbrook	John Burke	Total
Oct '20	2,673	3,700	110	292	930	784	1,013	236	1,322	59	62	1,272	135	12,588
Nov '20	3,274	5,000	271	454	1,097	928	1,232	300	1,731	65	74	1,679	184	16,289
Dec '20	4,677	8,300	235	626	1,225	1,061	1,456	361	2,386	65	79	2,011	253	22,735
Jan '21	4,504	6,100	202	541	1,243	987	1,318	312	2,173	57	61	1,577	218	19,293
Feb '21	3,994	6,000	180	540	1,550	935	1,400	308	2,060	55	55	1,508	215	18,800
Mar '21	2,749	4,900	190	482	1,234	907	1,669	288	1,813	62	61	1,520	173	16,048
Apr '21	2,812	5,000	191	459	1,088	910	1,297	272	1,725	63	65	1,490	156	15,528
May '21	2,384	3,800	144	319	1,027	665	858	175	1,330	52	57	1,247	103	12,161
Jun '21	2,809	4,300	177	335	887	362	901	253	1,719	65	62	883	105	12,858
July '21	2,969	4,800	159	415	987	347	1,112	152	1,454	54	62	914	130	13,555
Aug '21	2,740	4,700	170	486	1,044	344	892	159	1,630	58	62	908	123	13,316
Sep '21	2,648	3,900	150	421	885	397	836	185	1,395	52	53	892	109	11,923
Average	3,186	5,042	182	448	1,100	719	1,165	250	1,728	59	63	1,325	159	15,425

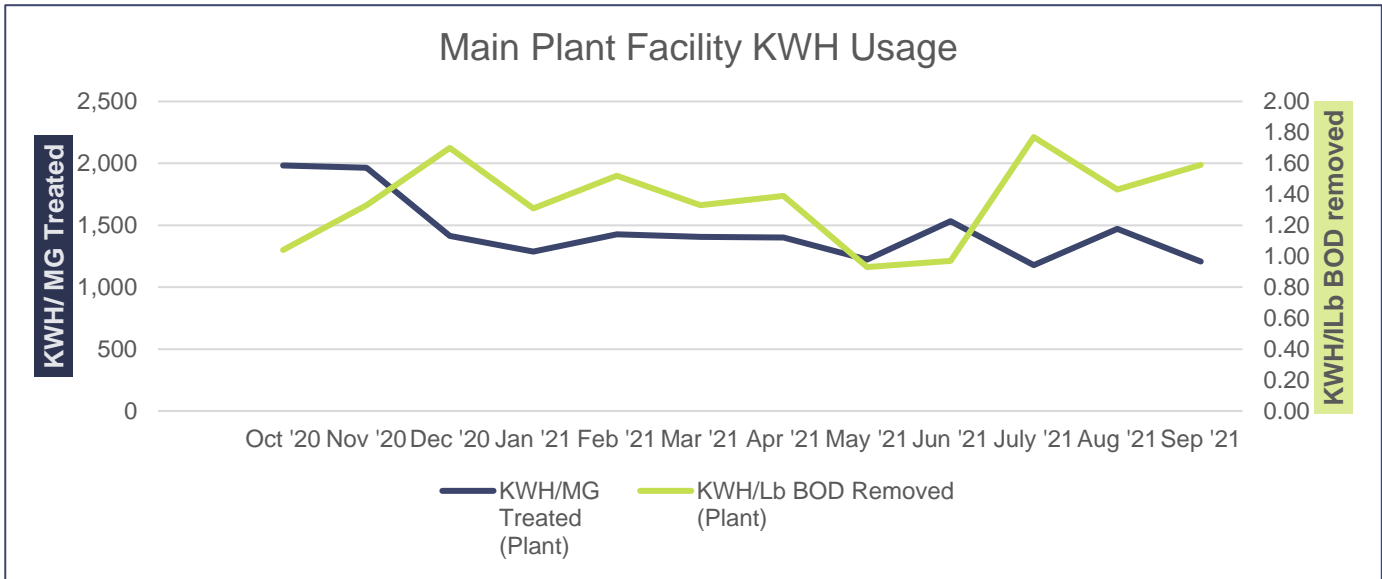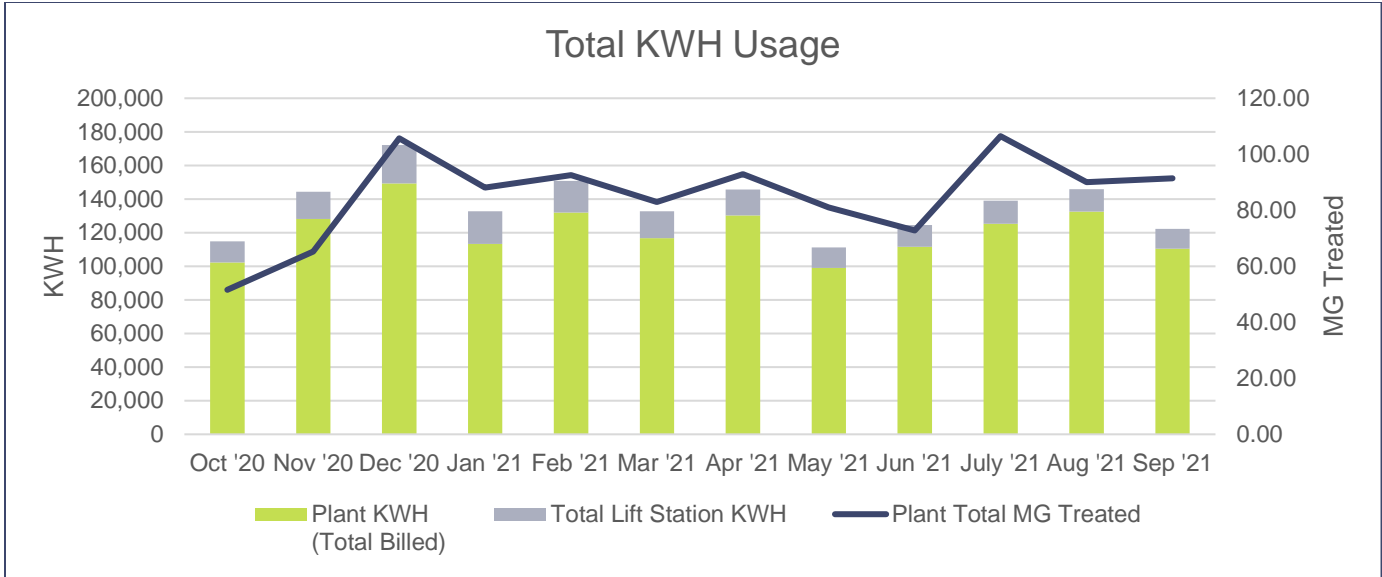

8.0 MAINTENANCE

8.1 WORK ORDER OVERVIEW

WO Type	Total This Month	Total This Year
Preventative Maintenance	160	1,337
Corrective Maintenance	10	108
Emergency Call Outs Total	3	37

8.2 SIGNIFICANT CORRECTIVE WORK ORDERS FOR THE MONTH

CM Description	WO #
1. OCW Pump 1 Bracket Repaired	20242
2. OCW Level Transducer Replaced	20244
3. Bisulfite Water Manifold Suction Line Replaced	20245
4. Final CL2 Analyzer Electrolyte Solution Replaced	20246
5. Influent Pump 3 Installed (Slot 1)	20250
6. Bisulfite Building Heater Thermostat Replaced	20251
7. Digester Gas Line Meter (Right) Cleaned and Lubricated	20252



OCW Pump Bracket Before and After

8.3 SIGNIFICANT OPEN WORK ORDERS

Open CM Description	WO #
1. Woodsbury Pump 2 Inspect and Repair	14917
2. Hingham South Pump #1 Repair / Replacement	17427
3. Lime Unloader # 3 shaft repair	13568
4. Hoist #11 Chain Replacement	19431
5. Effluent Pumps "HAND" control repair	14840
6. Chopper Pump 1 VFD Fan Installation	19471
7. WAS Pump 1 Mechanical Seal Replacement	19467
8. Digester Sludge Transfer Pump 3 Installation	19651
9. Fire Alarm LED Outside Main MCC Replacement	20241
10. Men Restroom Fire Alarm Strobe Replacement	20240
11. Influent Pump 1 Rebuild	20248

8.4 EMERGENCY CALL OUTS FOR THE MONTH

Type	Total this Month	Total this Year
Sewer Back Up / Collection System	0	2
Pump Station	1	20
Plant	1	13
Odor	0	0
Power Outages	1	12
Total:	3	47

1. 10/8/2021 Influent Pump Overload
 - a. GM called in at 5:00 AM for Influent Pump slot 3 Overload. Cleaned Pump, back online.

2. 10/21/2021 Spruce St.
 - a. EM called in at 8 PM for loss of air. Cleaned probe, back in service.

3. 10/27/2021 Loss of Power
 - a. Due to severe winds from a major storm, multiple trees and power lines down throughout the town. EM and GM in at 11 PM on 10/26 to monitor stations and main facility. Main Plant generator manually switched over to generator power at 1 AM to prevent power surges from quick power losses. Generator would continue to run until 10/28 at 1 PM. All stations without power from 2 AM on 10/26 until 3 PM on 10/28, except for Lincoln Avenue which was not restored until 10/29 at 730 PM. The trailer unit portable generator was placed at Lincoln Road (wired in by M&S) to allow staff to manual pump down station as needed - all other non-generator equipped stations pumped down manually by staff through the loss of power period.

8.5 INSPECTIONS / ANNUAL PMS COMPLETED DURING THE MONTH

1. All pump station alarms checked
2. Spruce and Butternut probes cleaned weekly
3. Eye wash inspections completed weekly
4. Fire extinguisher inspections completed monthly
5. Annual Facility Fire Alarm Inspection Completed by Sounder Systems on 10/18/21

8.6 COLLECTION SYSTEM AND IPP ASSISTANCE PERFORMED BY SUEZ

COLLECTION SYSTEM ASSISTANCE:


Type	Total This Month	Total This Year
Sewer Inspection / Tie-Ins	0	0
Sewer Location mark Outs	0	0
Sewer Back Up	0	0

INDUSTRIAL PRE TREATMENT ASSISTANCE:

Parameter	Monthly Total	Annual Total
Grease Trap Inspections	0	0
Bi-Annual Permit Renewals	0	0
Bi-Annual Permit Issuance	0	0
Annual IPP Final/Raw Sampling	0	0
EPA IPP Audit / Inspection	0	0

8.7 WORK ORDER STATISTICS

There were **190.12** total reported maintenance hours during the month. Of this total, outside contractors accounted for **5%** with **10** hours recorded.

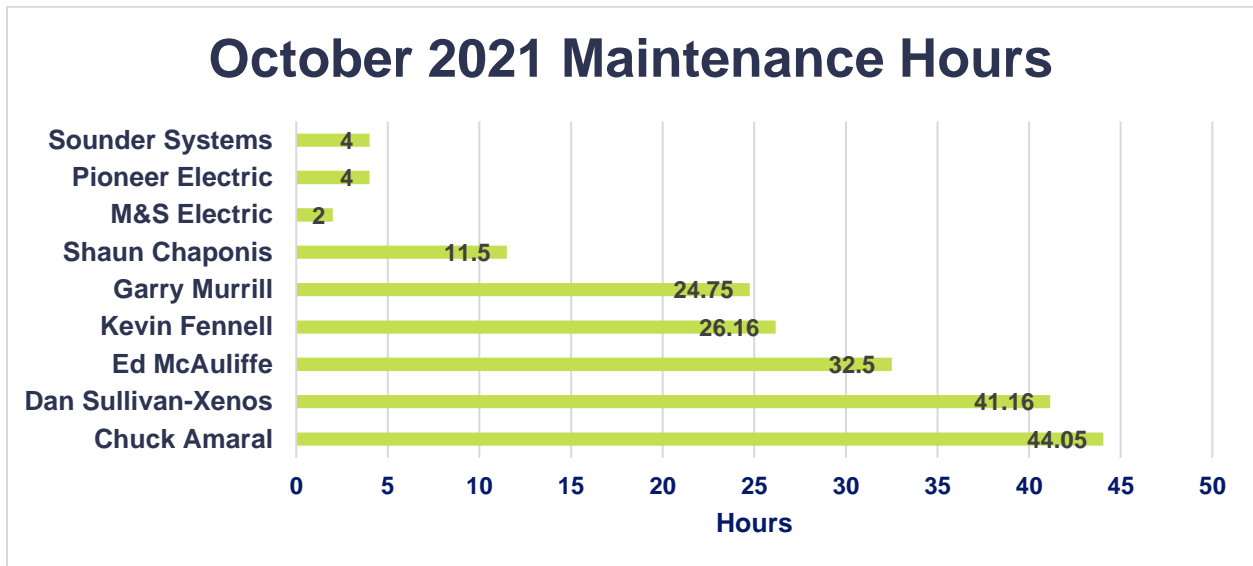

9.0 ATTACHED REPORTS

- Discharge Monitoring Report
- HACH Wims Data Reports
- Cumulative and Monthly Violation Reports
- Financial Reports
- Solids Removal Summary