


November 2021

Monthly Operating Report









Mr. David P. Taylor
Rockland Interim Sewer Superintendent
587 Rear Summer Street
Rockland, MA 02370
RE: Rockland Wastewater Facility
Monthly Report—November 2021
Dear Mr. Taylor,
Please see the enclosed November 2021 Monthly Operating Report (MOR) for the Suez Operations and Maintenance contract.
Please contact me at your earliest convenience should you have any questions regarding this report.
Sincerely,
Rick Kotouch
SUEZ Project Manager
CC: Charles Heshion
Dan Duross

NOVEMBER 2021 MONTHLY OPERATING REPORT

1. SUMMARY:

- 1) The facility will be reporting 1 exceedance for the month of November 2021.
 - 1) Monthly Average flow was reported as 3.125 MGD, NPDES limit is 2.5 MGD
- 2) There were no lost time / first aid injuries throughout the month
- 3) The facility treated a total of 98.885 Million Gallons.
- 4) The total rainfall for this reporting period was 1.84"
- 5) I&I Work is ongoing
- 6) **197** work orders were closed in November, with **12** as corrective maintenance work orders, **4** of the 12 were emergency call outs, while **1** was related to the collection system.
- 7) New permit still pending from EPA

2. STAFFING:

As of 11/17/2021, Operator *Kevin Fennell* is no longer working at the Rockland WWTP. Kevin has decided to move on and serve his country by joining the Navy. The Rockland team is very proud of Kevin for making this sacrifice and wish him the best of luck as he moves forward with his military service. A posting for his position is currently up as we look to fill his Operator in Training position.



	Current Employee Licenses as of 11/17/2021										
				Wastewater			NEWEA Collections			NEWEA Laboratory	
Employee	Title	1C Forklift	Boom Truck		5C	7C	-1	П	IV	-	
Rick Kotouch	Project Manager					x			х		
Edwin McAuliffe	Asst. Project Manager		х			х		х		х	
Steven Butts	Lab Technician					х				х	
Chuck Amaral	Maintenance Foreman		х		х			Х			
Megan Kelly Lynch	Operator	x				x					
Shaun Chaponis (Part Time Weekends)	Operator				х		х				
Garry Murrill	Operator				х			х			
Dan Sullivan-Xenos	Operator				х						

3. EMPLOYEE HEALTH AND SAFETY:

Throughout the COVID-19 (Coronavirus) pandemic in an attempt to continue to serve the Town of Rockland with reliable operations and protect the staff of the Rockland team, SUEZ has implemented numerous procedures to ensure continuity of the operations. As the COVID-19 Delta variant continues and the new Omicron, SUEZ at the Rockland facility has upgraded to a Threat Level 2 guideline as follows:


All Suez employees, visitors, and contractors will use face covering indoors except when at their assigned seat or when eating or drinking. All unvaccinated employees must wear a KN/N-95 respirator based on a risk assessment.


Visitors are still recommended to call ahead to set up appointments for in person visits at the site. All contractors and sales personnel are still required to be screened before entering the premises and meet the Covid visitor guidelines.

4 FOWS AND LOADINGS:

4.0 FLOWS, PRECIPITATION, AND WEATHER

- The facility treated a total of 93.740 MG during the month. The daily average flow was 3.125 MGD. This was 0.95 MGD more than the previous November monthly average, which was recorded at 2.175 MGD. The highest *peak* flow was recorded on November 1 as 5.17 MGD. The lowest instantaneous flow was 1.33 MGD, recorded November 30.
- The highest daily flow was recorded on November 2 as **4.960** MGD. The lowest daily flow was recorded on November 29 as **2.48** MGD.
- A total of **1.84**" of precipitation was received at the facility. The highest single day precipitation total was recorded on November 12 as **1.05**"
- The coldest day was November 30 at 26°F. The warmest day was November 18 at 70°F.

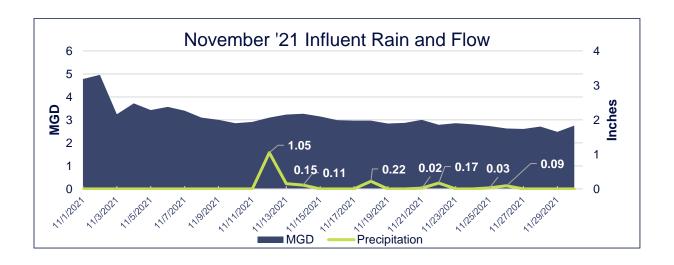

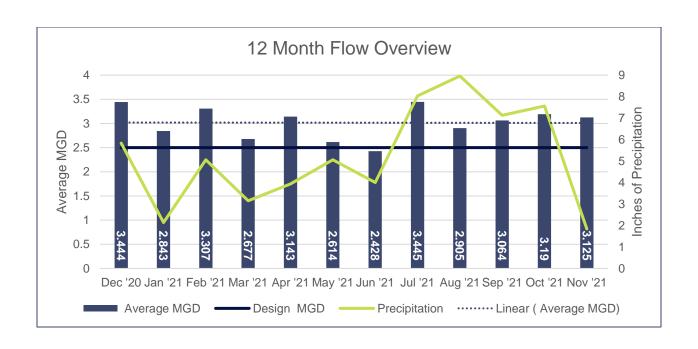


4.1 INFLUENT BOD AND TSS LOADINGS

	ROCKLAND FLOW AND LOADINGS TRACKING										
Month/Yr	Inf. Flow	Inf BOD	Inf. TSS	Inf. Flow Mov. Avg.	Inf. BOD Mov. Avg.	Inf. TSS Mov. Avg.					
	MGD	LBS	LBS	MGD	LBS	LBS					
Dec '20	3.444	2,929	4,128	2.421	3,166	4,358					
Jan '21	2.843	2,900	3,237	2.431	3,124	4,065					
Feb '21	3.307	3,253	4,139	2.499	3,090	3,933					
Mar '21	2.677	2,907	3,256	2.495	3,043	3,860					
Apr '21	3.143	3,189	3,630	2.418	3,031	3,814					
May '21	2.614	3,485	3,644	2.38	3,064	3,802					
Jun '21	2.428	3,874	3,572	2.419	3,112	3,790					
Jul '21	3.445	2,344	3,371	2.569	3,080	3,784					
Aug '21	2.905	3,044	4,011	2.683	3,118	3,798					
Sep '21	3.064	2,376	4,904	2.809	3,064	3,859					
Oct '21	3.190	2,990	3,889	2.936	3,046	3,815					
Nov '21	3.125	2,270	3,500	3.015	2,963	3,774					


4.2 LIFT STATION FLOWS


The lift stations accounted for **10,018,199** gallons throughout the month, **10.1%** the total plant flow. Please note that monthly lift station flow totals are purely estimates based off of pump run hours and estimated flow rates. Values are not intended to in any way be used as design capacity volumes for potential future rehab / replacement projects.


Total Flows	Total Flows for November 2021								
Station	Total Gallons	% Off 12 Month Avg.							
Millbrook	927,720	-11%							
Summer	30,000	3%							
Market	474,000	-4%							
John Burke	68,880	6%							
Lincoln, Forest	1,386,000	1%							
Wheeler	19,800	0%							
Woodsbury	1,463,401	9%							
OCW, HN, HS	5,648,398	-6%							
Total:	10,018,199	-3%							

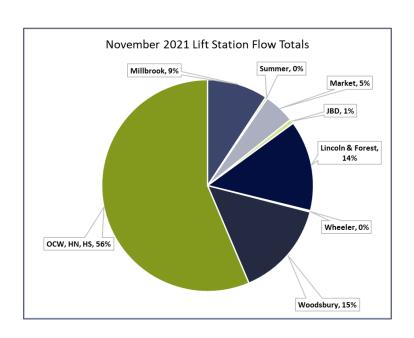

	Lift Station Monthly Average Daily Flows (GPD)										
Month	Millbrook	Sumer	Market	John Burke	Lincoln	Forrest	Wheeler	Woodsbury	Old Country Way	Hingham North	Hingham South
	GPD	GPD	GPD	GPD	GPD	GPD	GPD	GPD	GPD	GPD	GPD
Dec '20	35,316	984	14,900	1,992	1,580	37,660	714	46,140	62,300	136,440	219,240
Jan '21	41,688	952	15,050	2,024	1,540	37,800	726	46,380	60,130	136,800	211,680
Feb '21	34,272	832	15,250	2,016	2,100	41,440	684	44,880	59,850	148,500	188,640
Mar '21	37,656	1,024	15,700	1,928	2,260	41,650	738	45,540	58,800	148,500	183,960
Apr '21	34,020	984	17,450	2,064	2,280	41,580	762	51,720	63,770	160,920	205,560
May '21	33,876	968	16,950	1,880	2,160	37,590	678	36,060	59,220	152,640	184,320
June '21	34,272	1,000	16,400	2,112	5,020	46,410	708	33,720	51,240	153,360	172,080
July '21	33,166	952	17,226	2,183	4,684	54,126	732	36,813	68,894	199,974	227,845
Aug '21	30,345	968	16,887	2,563	2,826	53,042	761	44,594	62,797	169,839	190,568
Sept '21	30,348	968	17,000	2,560	2,840	52,990	768	44,700	63,070	170,460	191,160
Oct '21	29,822	898	15,339	2,121	3,252	51,552	639	50,458	65,303	163,568	187,084
Nov '21	30,924	1,000	15,800	2,296	3,600	46,200	660	48,780	62,930	159,120	188,280
Average	33,809	961	16,163	2,145	2,845	45,170	714	44,149	61,525	158,343	195,868

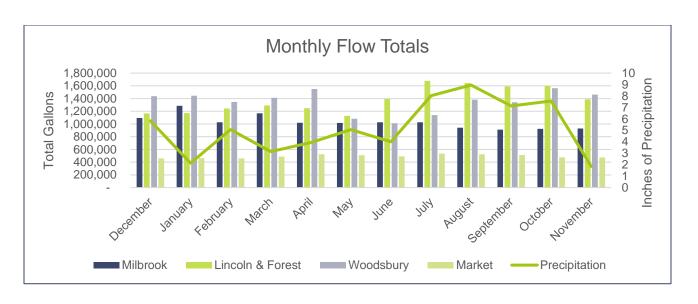

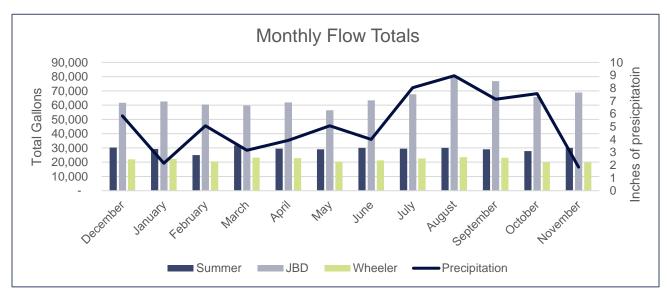


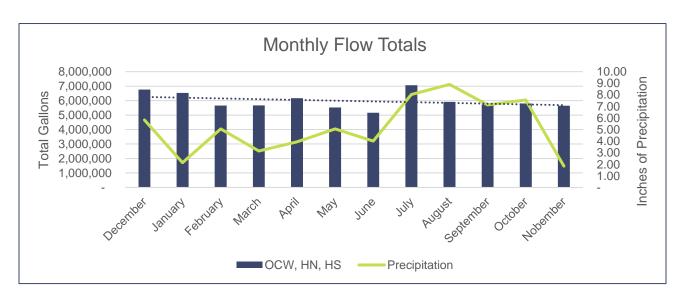

5.0 SOLIDS HANDLING

The BFP was operated a total of **120** hours this month and a total of **398,853** gallons were processed producing **120** Wet Tons of sludge that was hauled from the facility. The average BFP feed percent solids were **2.25%** and the BFP Cake average percent solids were **20.40%**. The digester feed to BFP differential was **40,909** gallons (overflow) for the month. The sludge processing Dry Tons conversion sheet is attached to this report.

Date	BFP Run Hours	Total Digester Feed	Total BFP Feed	Polymer Used	Actual Sludge Weight	Average Press Feed Total Solids	Average Cake Total Solids	Sludge Pick Up	Grit Removed
	HRS	Gal.	Gal.	Gal.	Wet Tons	%	%	Dumpster	Tons
Dec '20	177.0	432,663	582,869	137.8	116.1	1.52	20.00	7.00	
Jan '21	129.0	468,846	421,221	103.2	106.6	2.44	19.27	5.00	
Feb '21	146.0	403,368	540,139	92.0	93.5	2.00	19.19	6.00	
Mar '21	190.3	560,191	600,688	142.4	152.4	2.08	19.16	7.00	
Apr '21	172.5	585,402	564,039	131.3	142.1	2.48	20.23	8.00	
May '21	161.5	504,683	470,321	108.0	124.6	2.62	21.62	7.00	
Jun '21	148.3	447,325	460,923	109.1	104.5	2.16	23.59	6.00	
Jul '21	129.3	536,074	495,343	90.4	113.3	2.33	21.29	7.00	
Aug '21	154.6	538,761	641,667	128.7	136.1	1.97	21.24	7.00	
Sep '21	154.3	459,723	594,127	133.0	129.2	1.75	21.08	6.00	4
Oct '21	108.5	515,074	420,101	86.6	118.9	2.67	21.17	5.00	
Nov '21	120.0	439,762	398,853	90.4	120.0	2.25	20.40	7.00	
Annual Total	1,791	5,891,872	6,190,291	1,353	1,457	****	****	78	4.00
Avg.	149	490,989	515,858	113	121	2.19	20.69	6.5	****

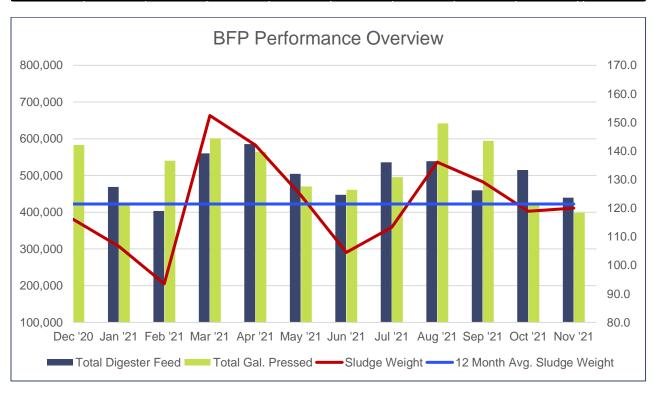

6.0 ENVIRONMENTAL COMPLIANCE

6.1 REGULATORY REPORTING

- 1. EPA NETDMR submitted on the CDX website on 12/13/21
- 2. MADEP MOR mailed on 12/13/2021

6.2 NPDES COMPLIANCE

The facility will be reporting (1) exceedance for the month of November 2021

1) Monthly Average flow was reported as **3.125** MGD. NPDES limit is 2.5 MGD

Date	Plant Flow	BOD	BOD	TSS	TSS	NH3	Total P	Ph	Fecal Coliform	Aluminum	Copper	Dissolved Oxygen	Limits	Monthly Avg.	Weekly Avg.	Daily Max
	MGD	Mg/L	Lbs./Day	Mg/L	Lbs./Day	Mg/L	Mg/L	Ph	CFU/100 ml	Ug/L	Ug/L	Mg/L	BOD			
Mon, Nov 01	4.780	1.16/ 2	250ij 2 dij	1126/2	2001/24y	1.18/ 2	1.1g/ 2	7.21	96	06/2	06/2	1.1g/ 2	Oct. 1 -	20 Mg/L	20 Mg/L	30 Mg/l
Tue, Nov 02	4.960	2.5	103	2.0	83	0.20	0.21	7.37	118	14	5.5		Aprill 30	417 bs/day	417 lbs/Day	626 lbs/Day
Wed, Nov 03	3.250							7.40					May1 -	6 Mg/L	6 Mg/L	10Mg/L
Thu, Nov 04	3.720	3.0	93	2.0	62	1.00	0.32	7.21					Sept. 30	125 Lbs/Day	125 lbs/Day	209 Lbs/day
Fri, Nov 05	3.430							7.39					TSS	Ths/Lav		Ths/nav
Sat, Nov 06	3.570							7.24					Oct. 1 -	20 Mg/L	20 Mg/L	30 Mg/I
Sun, Nov 07	3.400							7.29	92				Aprill 30	417 Lbs/Day	417 Lbs/Day	626 lbs/Day
Mon, Nov 08	3.100							7.42	210				May1 -	10 Mg/L	10 Mg/L	15Mg/L
Tue, Nov 09	3.000	2.0	50	2.0	50	0.20	0.42	7.43					Sept. 30	209 Lbs/Day	209 lbs/Day	313 Lbs/day
Wed, Nov 10	2.860							7.42	200				NH3	1-17-11-21-1		
Thu, Nov 11	2.910	3.0	73	2.0	49	0.20		7.37					Oct.1 - Mar.			
Fri, Nov 12	3.100							7.43					31	3.3 Mg/L	3.3 Mg/l	5.7 Mg/L
Sat, Nov 13	3.230							7.39					Apr. 1 -	0.5.144	0.5.14-4	5.7.14-0
Sun, Nov 14	3.270							7.33	52				May 31	2.5 Mg/L	2.5 Mg/l	5.7 Mg/l
Mon, Nov 15	3.150							7.45	48				June1 -	4.0 M=/I	4.0 Ma//	4 5 Mm/l
Tue, Nov 16	2.990	3.0	75	3.0	75	0.20	0.49	7.43	52				Sept. 30	1.0 Mg/L	1.0 Mg/L	1.5 Mg/L
Wed, Nov 17	2.970							7.38					Total Phps	phorus		
Thu, Nov 18	2.970	3.0	74	2.0	50	0.20		7.43					Apr.1 -	0.2 Mg/L	******	******
Fri, Nov 19	2.840							7.34					Oct.31	U.Z IVIG/L		
Sat, Nov 20	2.870							7.32					Nov. 1 -	1.0 Mg/L	******	******
Sun, Nov 21	3.000							7.38	57				Mar. 31	1.0 Wg/L		
Mon, Nov 22	2.790							7.36	114				Ph			
Tue, Nov 23	2.860	3.0	72	2.0	48	0.20	0.52	7.46	115					6.5	- 8.3	
Wed, Nov 24	2.810	3.0	70	2.0	47	0.74		7.35					Fecal			
Thu, Nov 25	2.730							7.35					******	200	******	400
Fri, Nov 26	2.630							7.43						CFU/100ml		CFU/100ml
Sat, Nov 27	2.610							7.35					Aluminum			
Sun, Nov 28	2.710							7.33	25				******	88 ug/l	******	*******
Mon, Nov 29	2.480							7.39	212				Copper			
Tue, Nov 30	2.750	4.4	101	3.0	69	0.20	0.44	7.37	196				******	12 ug/l	******	*******
													Dissolved C	Oxygen		
Daily Max	4.960	4.40	103.42	3.00	82.73	1.00	0.52	7.46	212	******	******	******	May 1 - Sept. 30		> 7.4 mg/L	
Daily Min.	2.480	******	******	******	******	*******	******	7.21	*****	******	******		55550	Plant	Flow	
Month Avg.	3.125	2.99	79.00	2.22	59.22	0.35	0.4	7.37	113.36	14	5.5	******		2.5	MGD	

7.0 ENERGY CONSUMPTION


7.1 ELECTRICAL OVERVIEW


Due to billing cycle timing, all electrical data in the MOR will be one month behind. The following data is for electrical consumption during the *October 2021* operating period.

The department used a total of **120,638** *KWH* for the month of Oct. 2021. Of this total, the lift stations accounted for *11.2%*, using *13,538* KWH. The Main Plant accounted for the remaining *107,100* KWH. The KWH/ MG treated was *1,087* for the month, which is *25.4%* lower than the previous 12-month average of *1,458* KWH/MG. The KWH/Lb. BOD Removed was *1.18* KWH/Lb. for the month, which is *13%* higher than the previous 12-month average of *1.36* KWH/Lb.

	Monthly Energy Consumption										
Month	Plant Average Daily Flow (NO HFMP)	Plant Total Influent Flow	Plant KWH (Total Billed)	KWH/MG Treated (Plant)	Plant Lbs BOD Removed	KWH/Lb BOD Removed (Plant)	Off Peak Demand (Plant)	Peak Demand (Plant)	Total Lift Station KWH	Total KWH (Plant & Stations)	
	MGD	MG	KWH	KWH/MG	Lbs	KWH/Lb	KW	KW	KWH	KWH	
Nov '20	2.17	65.24	128,100	1,964	96,589	1.33	231	246	16,289	144,389	
Dec '20	3.41	105.75	149,400	1,413	87,985	1.70	246	246	22,735	172,135	
Jan '21	2.84	88.12	113,400	1,287	86,723	1.31	222	240	19,293	132,693	
Feb '21	3.31	92.59	132,000	1,426	86,598	1.52	216	228	18,800	150,800	
Mar '21	2.68	83.00	116,700	1,406	87,712	1.33	198	216	16,048	132,748	
Apr '21	3.1	92.87	130,200	1,402	93,957	1.39	219	219	15,528	145,728	
May '21	2.61	81.02	99,000	1,222	106,715	0.93	186	189	12,161	111,161	
Jun '21	2.43	72.83	111,600	1,532	114,694	0.97	219	228	12,858	124,458	
July '21	3.43	106.47	125,400	1,178	70,944	1.77	222	249	13,555	138,955	
Aug '21	2.91	90.06	132,600	1,472	92,787	1.43	249	255	13,316	145,916	
Sep '21	3.05	91.41	110,400	1,208	69,519	1.59	204	231	11,923	122,323	
Oct '21	3.18	98.51	107,100	1,087	90,595	1.18	231	234	13,538	120,638	
Average	2.93	88.99	121,325	1,383	90,402	1.37	220	232	15,504	136,829	

						Monthly	Lift Statio	n KWH						
Month	Hingham North	Hingham South	Spruce	Butternut	Old Country Way	Market	Woodsbury	Lincoln	Forest	Wheeler	Summer	Milbrook	John Burke	Total
Nov '20	3,274	5,000	271	454	1,097	928	1,232	300	1,731	65	74	1,679	184	16,289
Dec '20	4,677	8,300	235	626	1,225	1,061	1,456	361	2,386	65	79	2,011	253	22,735
Jan '21	4,504	6,100	202	541	1,243	987	1,318	312	2,173	57	61	1,577	218	19,293
Feb '21	3,994	6,000	180	540	1,550	935	1,400	308	2,060	55	55	1,508	215	18,800
Mar '21	2,749	4,900	190	482	1,234	907	1,669	288	1,813	62	61	1,520	173	16,048
Apr '21	2,812	5,000	191	459	1,088	910	1,297	272	1,725	63	65	1,490	156	15,528
May '21	2,384	3,800	144	319	1,027	665	858	175	1,330	52	57	1,247	103	12,161
Jun '21	2,809	4,300	177	335	887	362	901	253	1,719	65	62	883	105	12,858
July '21	2,969	4,800	159	415	987	347	1,112	152	1,454	54	62	914	130	13,555
Aug '21	2,740	4,700	170	486	1,044	344	892	159	1,630	58	62	908	123	13,316
Sep '21	2,648	3,900	150	421	885	397	836	185	1,395	52	53	892	109	11,923
Oct '21	2,754	4,000	179	529	908	697	1,142	225	1,667	49	57	1,215	116	13,538
Average	3,193	5,067	187	467	1,098	712	1,176	249	1,757	58	62	1,320	157	15,504

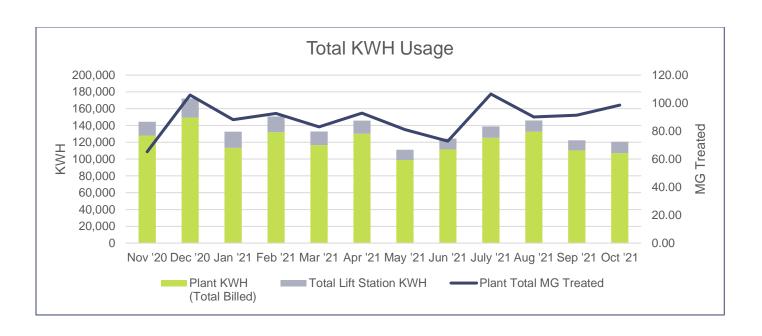

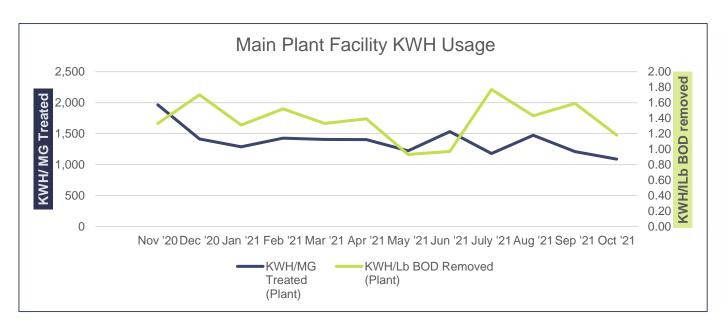

8.0 MAINTENANCE

8.1 WORK ORDER OVERVIEW

WO Type	Total This Month	Total This Year
Preventative Maintenance	183	1,520
Corrective Maintenance	12	120
Emergency Call Outs Total	4	41

8.2 SIGNIFICANT CORRECTIVE WORK ORDERS FOR THE MONTH

	CM Description	WO #
1.	Effluent Pump #1 VFD Replacement	14840
2.	Secondary Clarifier #2 Draft Tubes Cleared	11/8
3.	BFP Drain Line Blocked / Cleared	11/19
4.	Bisulfite Bldg. Heater Thermostat Replaced	11/2
5.	Digester Boiler Gas Solenoid Replaced	11/5
6.	Hypo Pump 1 Tube Replaced and Calibrated	11/5
7.	Secondary Clarifier #1 Draft Tubes Cleared	11/8
8.	Hingham North and Hingham South Wet Wells Cleaned	11/3 & 11/10



BFP Drain Line Plugged



Hingham South WW Cleanout

8.3 SIGNIGICANT OPEN WORK ORDERS

	Open CM Description	WO #
3.	Woodsbury Pump 2 Inspect and Repair	14917
4.	Hingham South Pump #1 Repair / Replacement	17427
5.	Lime Unloader # 3 shaft repair	13568
6.	Chopper Pump 1 VFD Fan Installation	19471
7.	WAS Pump 1 Mechanical Seal Replacement	19467
8.	Digester Sludge Transfer Pump 3 Installation	19651
9.	Fire Alarm LED Outside Main MCC Replacement	20241
10.	Men Restroom Fire Alarm Strobe Replacement	20240
11.	Influent Pump 1 Rebuild	20248

8.4 EMERGENCY CALL OUTS FOR THE MONTH

Туре	Total this Month	Total this Year
Sewer Back Up / Collection System	1	3
Pump Station	1	21
Plant	2	15
Odor	0	0
Power Outages	0	12
Total:	4	51

8.5 INSPECTIONS / ANNUAL PMS COMPLETED DURING THE MONTH

- 1. All pump station alarms checked
- 2. Spruce and Butternut probes cleaned weekly
- 3. Eye wash inspections completed weekly
- 4. Fire extinguisher inspections completed monthly

8.6 COLLECTION SYSTEM AND IPP ASSISTANCE PERFORMED BY SUEZ

COLLECTION SYSTEM ASSITANCE:

Туре	Total This Month	Total This Year
Sewer Inspection / Tie-Ins	0	0
Sewer Location mark Outs	2	2
Sewer Back Up	0	0

• EM and DS completed mark out at 48 Greenwood for Water Dept. on 11/19/21

INDUSTRIAL PRE TREATMENT ASSISTANCE:

Parameter	Monthly Total	Annual Total
Grease Trap Inspections	0	0
Bi-Annual Permit Renewals	0	0
Bi-Annual Permit Issuance	0	0
Annual IPP Final/Raw Sampling	0	0
EPA IPP Audit / Inspection	0	0

8.7 WORK ORDER STATISTICS

There were **190.12** total reported maintenance hours during the month. Of this total, outside contractors accounted for **5%** with **10** hours recorded.



9.0 ATTACHED REPORTS

- Discharge Monitoring Report
- HACH Wims Data Reports
- Cumulative and Monthly Violation Reports
- Financial Reports
- Solids Removal Summary