

Monthly Operating Report

NOVEMBER 2023



Rockland, MA WWTP





December 15, 2023

Mr. Chuck Heshion

Rockland Sewer Commission Chairman

587 Rear Summer Street

Rockland, MA 02370

RE: Rockland Wastewater Facility

Monthly Report—November 2023

Dear Mr. Heshion,

I have enclosed Novemebr's 2023 Monthly Operating Report (MOR) for the Veolia Operations and Maintenance contract.

Please contact me if you should you have any questions regarding this report.

Sincerely,

Rick Kotouch

Veolia Project Manager

CC:

Daniel Duross

Sherri Vallie

NOVEMBER 2023 MONTHLY OPERATING REPORT

1. SUMMARY:

The facility will be reporting **0** exceedance for the month of November 2023

- 1) There was **0** lost time / first aid injuries throughout the month.
- 2) The facility treated a total of **62,060,000** million gallons. The average daily flow was **2.069** MGD
- 3) The total rainfall for this reporting period was **1.72"**
- 4) I&I Work is ongoing
- 5) **170** work orders were closed in November, with **25** as corrective maintenance work order and **7** were emergency call outs
- 6) Massachusetts general wastewater permit began April 1st.



2. STAFFING:

Current Employee Licenses as of 09/14/2023										
		Hoisting		Wastewater			NEWEA Collections			NEWEA Laboratory
Employee	Title	1C Forklift	1B Boom Truck & Forklift	3M	5C	7C	I	II	IV	I
Richard Kotouch	Project Manager					X			X	
Megan Kelly-Lynch	Asst. Project Manager	X				X				
Steven Butts	Lab Technician					X				X
Charles Amaral	Maintenance Foreman				X			X		
Garry Murrill	Operator				X			X		
Maxwell Jackson	Operator			X						
Cristian Ryan	Operator									
Michael Hurley	Operator									
Shaun Chaponis (Part Time Weekends)	Operator				X		X			

3 FLOWS AND LOADINGS:

3.0 FLOWS, PRECIPITATION, AND WEATHER

- The facility treated a total of **62,060,000** MG during the month. The daily average flow was **2.069** MGD. This was **0.126** MGD less than the previous November monthly average, which was recorded at **2.295** MGD. The highest daily flow was recorded on November 5th as 2.270 MGD. The lowest daily flow was recorded on November 20th as **1.900** MGD.
- The highest **peak** flow was recorded on November 23rd as **3.450** MGD.
- A total of **1.72"** of precipitation was received at the facility. The highest single day precipitation total was recorded on November 21st as **.57"**.
- The coldest day was November 26th at **20°F**. The warmest day was November 17th at **65°F**.

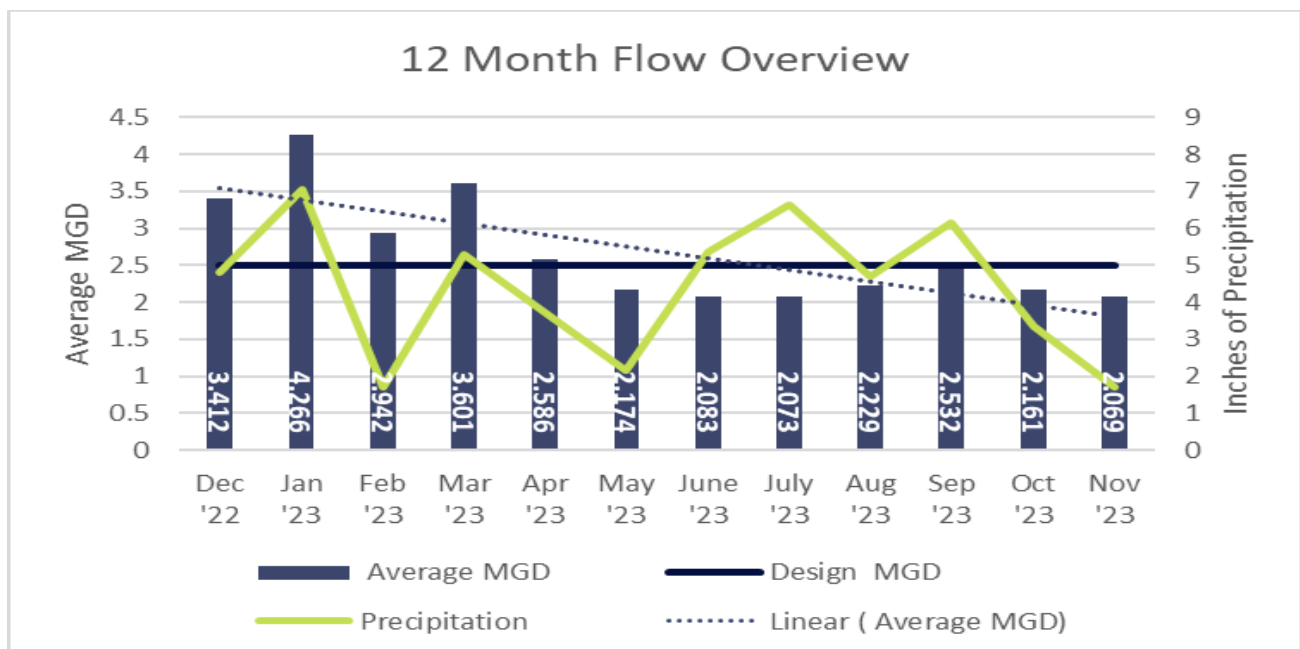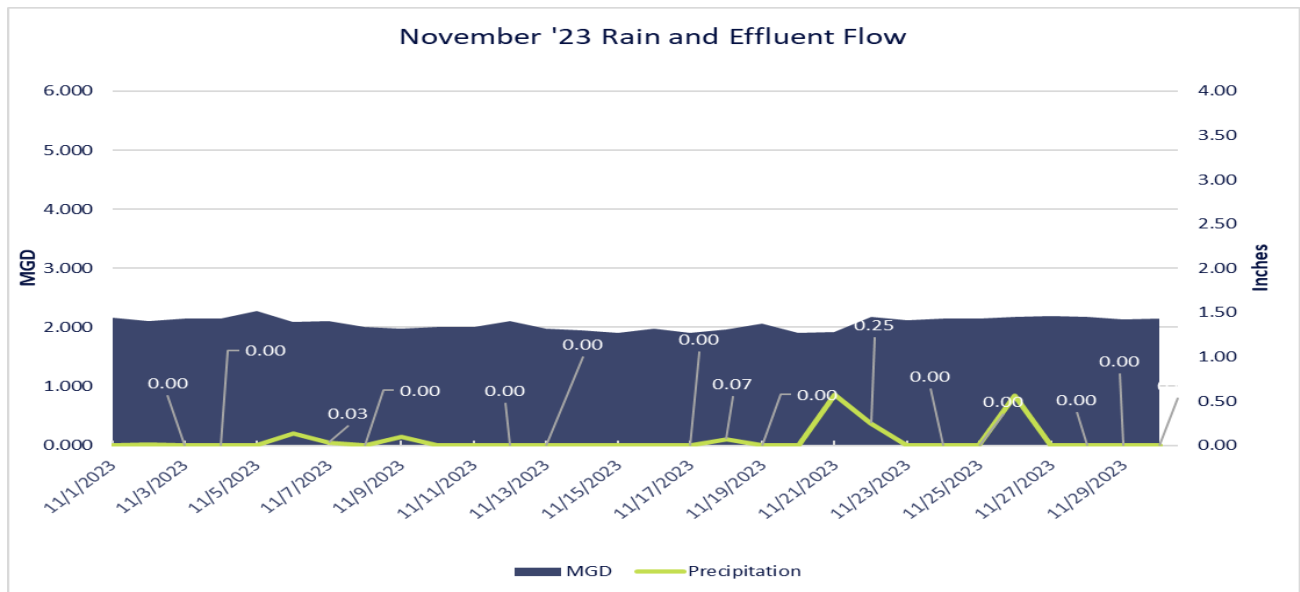


ROCKLAND FLOW AND LOADINGS TRACKING				
Month/Yr	Influent Flow	Effluent Flow	Influent Flow Moving Avg.	Effluent Flow Moving Avg.
	MGD	MGD	MGD	MGD
Dec'22	3.412		2.544	
Jan '23	4.266		2.670	
Feb '23	2.942	2.646	2.577	2.646
Mar '23	3.601	3.601	2.592	3.123
Apr '23	2.586	2.212	2.577	2.820
May '23	2.497	2.174	2.603	2.658
June '23	2.083	1.735	2.61	2.473
July '23	2.404	2.073	2.666	2.407
Aug '23	2.102	2.024	2.706	2.352
Sep '23	2.457	2.532	2.76	2.374
Oct '23	2.114	2.161	2.73	2.351
Nov '23	2.069	2.069	2.711	2.323

3.2 LIFT STATION FLOWS

The lift stations accounted for **8,144,084** gallons throughout the month, **13%** of the total plant flow. Please note that monthly lift station flow totals are purely estimates based off of pump run hours and estimated flow rates. Values are not intended to in any way be used as design capacity volumes for potential future rehab / replacement projects.


Total Flows for November 2023		
Station	Total Gallons	
Millbrook	841,324	
Summer	24,000	
Market	372,001	
John Burke	87,840	
Lincoln, Forest	1,625,398	
Wheeler	30,240	
Woodsbury	1,020,599	
OCW, HN, HS	4,071,582	
Butternut	71,100	
Total:	8,144,084	

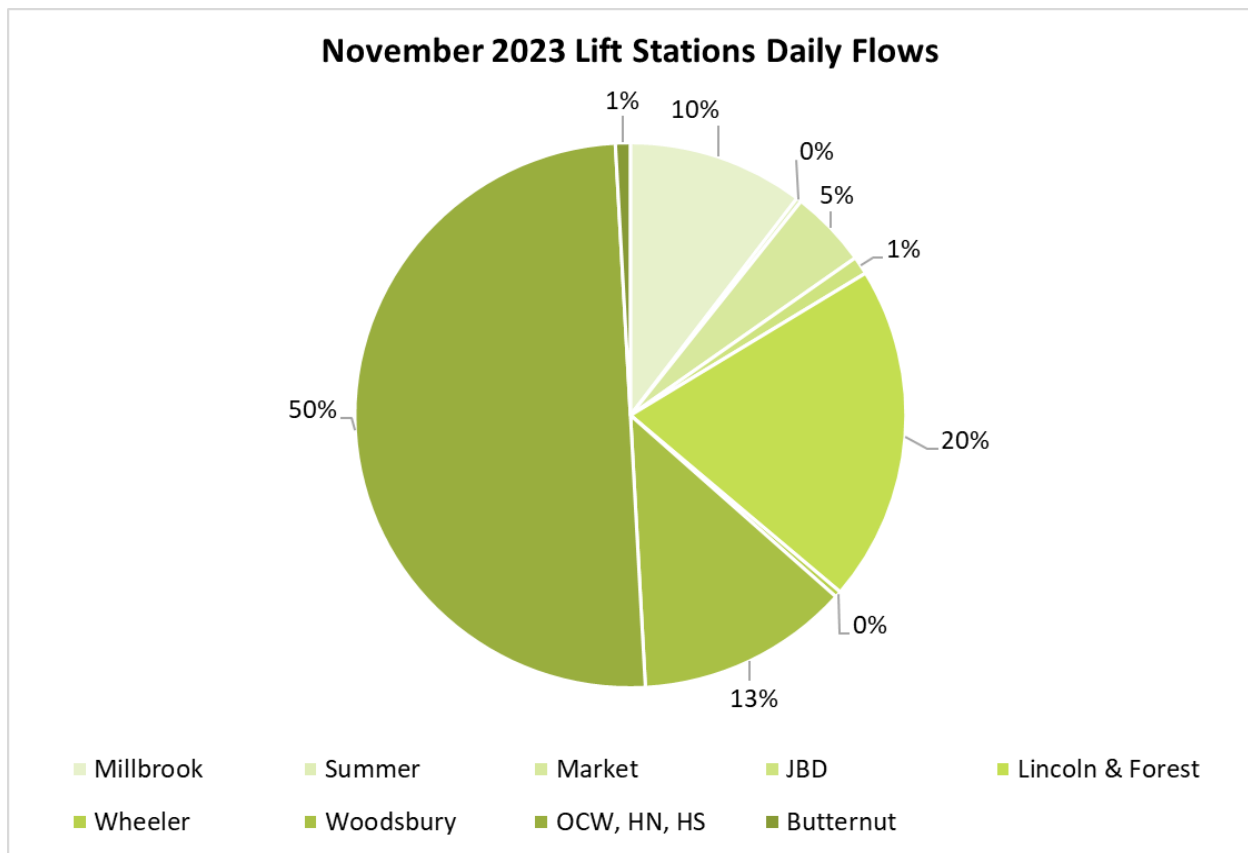

Lift Station Monthly Average Daily Flows (GPD)												
Month	Millbrook	Summer	Market	John Burke	Lincoln	Forrest	Wheeler	Woodsbury	Old Country Way	Hingham North	Hingham South	Butternut
	GPD	GPD	GPD	GPD	GPD	GPD	GPD	GPD	GPD	GPD	GPD	GPD
Dec '22	47,052	888	14,750	2,480	2,580	56,070	786	57,780	60,155	169,200	199,974	3658
Jan '23	47,052	888	14,750	2,480	2,580	56,070	786	57,780	60,155	169,200	199,974	3658
Feb '23	44,087	866	13,554	5,186	3,000	52,950	4,899	50,207	58,650	164,565	199,029	3182
Mar '23	48,137	1,029	14,893	3,180	3,879	56,625	868	52,650	69,450	172,221	220,629	4,243
Apr '23	46,209	994	15,054	3,180	3,343	57,150	861	52,714	53,325	137,507	170,486	3,857
May '23	36,566	874	15,321	4,226	2,786	49,800	784	40,436	52,425	145,800	180,514	2,796
June '23	32,516	831	12,964	2,983	2,250	50,100	746	34,393	49,575	33,264	178,200	2,411
July '23	32,554	960	13,339	2,897	2,721	54,300	778	44,550	54,300	151,971	174,343	2,475
Aug '23	43,894	857	13,875	3,180	3,086	57,600	5,001	58,243	67,200	180,707	219,858	4,146
Sep '23	30,356	857	13,554	1,637	2,679	51,300	765	45,321	52,650	153,900	166,628	2,379
Oct '23	36,720	866	14,250	1,843	2,550	50,850	784	57,343	50,325	145,414	156,986	2,025
Nov '23	30,047	857	13,286	3,137	2,743	58,050	1,080	36,450	46,650	130,757	145,414	2,539
Average	39,599	897	14,133	3,034	2,850	54,239	1,512	48,989	56,238	146,209	184,336	3,114

4.0 SOLIDS HANDLING

The BFP operated a total of **132** hours this month and a total of **381,901** gallons were processed producing **116** Wet Tons of sludge that was hauled from the facility. The average BFP feed percent solids were **2.18%** and the BFP Cake average percent solids were **22.12%**. The sludge processing Dry Tons conversion sheet is attached to this report.

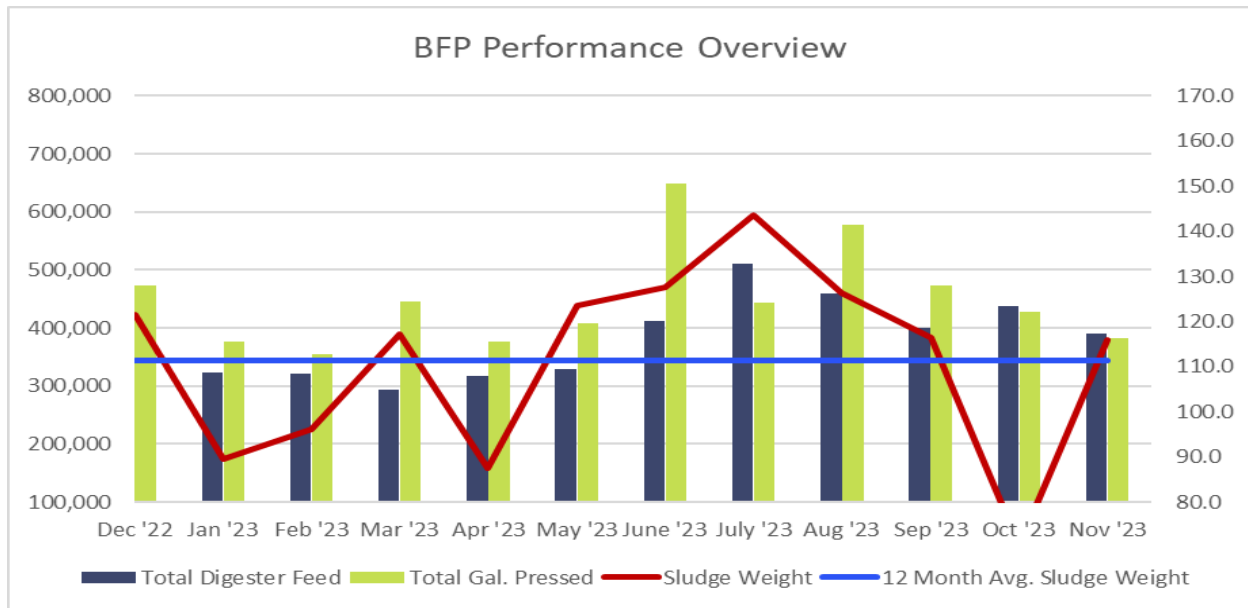

Date	BFP Run Hours	Total Digester Feed	Total BFP Feed	Polymer Used	Actual Sludge Weight	Average Press Feed Total Solids	Average Cake Total Solids	Sludge Pick Up	Grit Removed
	HRS	Gal.	Gal.	Gal.	Wet Tons	%	%	Dumpster	Tons
Dec '22	150.5	403,272	472,903	115.2	121.6	1.73	20.27	6.00	
Jan '23	129.2	324,034	377,362	119.2	89.4	1.72	19.24	6.00	
Feb '23	134.3	320,572	355,441	115.5	96.1	1.59	18.77	6.00	
Mar '23	147.1	293,999	445,395	128.8	117.1	1.62	18.98	6.00	
Apr '23	123.3	318,169	377,424	105.6	87.5	2.21	20.87	6.00	
May '23	125.6	329,820	407,350	114.4	123.5	2.08	21.52	6.00	
June '23	183.7	411,781	649,427	155.6	127.6	1.88	22.32	8.00	
July '23	128.4	444,319	510,385	109.6	143.6	2.11	21.39	7.00	
Aug '23	161.6	459,960	577,299	128.1	126.3	2.01	22.81	7.00	
Sep '23	142.7	400,268	473,224	113.6	116.4	1.92	22.35	6.00	
Oct '23	127.4	438,575	428,509	112.0	70.5	2.00	22.64	5.00	
Nov '23	132.4	389,377	381,901	108.8	116.0	2.18	22.12	8.00	
Annual Total	1,686	4,534,146	5,456,620	1,426	1,336	*****	*****	77	0.00
Avg.	140	377,846	454,718	119	111	1.92	21.11	6.4	*****

5.0 ENVIRONMENTAL COMPLIANCE

5.1 REGULATORY REPORTING

1. The EPA and MADEP November NETDMR was submitted on the CDX website on 12/8/2023.

5.2 NPDES COMPLIANCE

The facility will be reporting (0) exceedance(s) for the month of November 2023


Date	Plant Flow	BOD	BOD	TSS	TSS	NH3	Total P	Ph	E. Coli Coliform	Aluminum	Copper	Dissolved Oxygen	Limits	Monthly Avg.	Weekly Avg.	Daily Max
	MGD	Mg/L	Lbs./Day	Mg/L	Lbs./Day	Mg/L	Mg/L	Ph	CFU/100 ml	Ug/L	Ug/L	Mg/L	BOD			
Wed, Nov 1	2.160	7.0	126	6	108	0.10	0.12	7.57		4	3.0		Oct. 1 - April 30	20 Mg/L 417 lbs/day	20 Mg/L 417 lbs/Day	30 Mg/L 626 lbs/Day
Thu, Nov 2	2.110							7.66								
Fri, Nov 3	2.140							7.62					May1 - Sept. 30	6 Mg/L 125 lbs/Day	6 Mg/L 125 lbs/Day	10Mg/L 209 lbs/day
Sat, Nov 4	2.150							7.52								
Sun, Nov 5	2.270							7.57					TSS			
Mon, Nov 6	2.090							7.60					Oct. 1 - April 30	20 Mg/L 417 lbs/Day	20 Mg/L 417 lbs/Day	30 Mg/L 626 lbs/Day
Tue, Nov 7	2.100							7.61	110							
Wed, Nov 8	2.000	5.0	83	5.0	83			7.60					May1 - Sept. 30	10 Mg/L 209 lbs/Day	10 Mg/L 209 lbs/Day	15Mg/L 313 lbs/day
Thu, Nov 9	1.970							7.51								
Fri, Nov 10	2.010							7.45					NH3			
Sat, Nov 11	2.010							7.55					Oct.1 - Mar. 31	3.3 Mg/L	3.3 Mg/l	5.7 Mg/L
Sun, Nov 12	2.100							7.54								
Mon, Nov 13	1.980							7.53					Apr. 1 - May 31	2.5 Mg/L	2.5 Mg/l	5.7 Mg/l
Tue, Nov 14	1.950							7.53	54				June1 - Sept. 30	1.0 Mg/L	1.0 Mg/L	1.5 Mg/L
Wed, Nov 15	1.910	4.0	64	2.0	32	0.90	0.08	7.55								
Thu, Nov 16	1.970							7.57								
Fri, Nov 17	1.910							7.59					Total Phosphorus			
Sat, Nov 18	1.960							7.61					Apr.1 - Oct.31	0.2 Mg/L	*****	*****
Sun, Nov 19	2.060							7.54								
Mon, Nov 20	1.900							7.56					Nov. 1 - Mar. 31	1.0 Mg/L	*****	*****
Tue, Nov 21	1.920							7.56	143							
Wed, Nov 22	2.170	4.0	72	2.0	36			7.63					Ph			
Thu, Nov 23	2.120							7.64					6.5 - 8.3			
Fri, Nov 24	2.150							7.66					E. Coli			
Sat, Nov 25	2.150							7.56					*****	126 CFU/100ml	*****	409 CFU/100ml
Sun, Nov 26	2.170							7.48								
Mon, Nov 27	2.190							7.63					Aluminum			
Tue, Nov 28	2.170							7.58	68				*****	88 ug/l	*****	*****
Wed, Nov 29	2.130	10.0	178	6.0	107			7.58					Copper			
Thu, Nov 30	2.140							7.60								
Daily Max	2.270	10.00	177.64	6.00	108.09	0.90	0.12	7.66	143.00	*****	*****	*****	May 1 - Sept. 30	> 7.4 mg/L		
Daily Min.	1.900	*****	*****	*****	*****	*****	*****	7.45	*****	*****	*****	*****	Plant Flow			
Month Avg.	2.069	6.00	104.60	4.20	73.20	0.50	0.1	7.57	87	4	3.0	*****	2.5 MGD			

6.0 ENERGY CONSUMPTION

6.1 ELECTRICAL OVERVIEW


The department used a total of **120,013 KWH** for the month of November 2023. Of this total, the lift stations accounted for **12.8%**, using **15,313 KWH**. The Main Plant accounted for the remaining **104,700 KWH**. The KWH/ MG treated was **1,563** for the month and the KWH/Lb. BOD Removed was **0.78 KWH/Lb.** for the month.

Month	Plant Average Daily Flow (NO HFMP)	Plant Total Influent Flow	Plant KWH (Total Billed)	KWH/MG Treated (Plant)	Plant Lbs BOD Removed	KWH/Lb BOD Removed (Plant)	Off Peak Demand (Plant)	Peak Demand (Plant)	Total Lift Station KWH	Total KWH (Plant & Stations)
	MGD	MG	KWH	KWH/MG	Lbs	KWH/Lb	KW	KW	KWH	KWH
Nov '22	2.3	68.86	124,800	1,812	146,152	0.85	186	213	15,469	140,269
Dec '22	3.36	104.19	146,400	1,405	127,264	1.15	243	258	19,421	165,821
Jan '23	4.08	126.55	134,400	1,062	126,998	1.06	252	258	20,049	154,449
Feb '23	2.94	82.38	125,400	1,522	92,522	1.36	213	210	16,712	142,112
Mar '23	3.33	103.31	129,600	1,254	103,530	1.25	204	213	16,322	145,922
Apr '23	2.59	77.57	116,400	1,501	130,686	0.89	198	210	15,893	132,293
May '23	2.5	77.4	118,800	1,535	151,100	0.79	183	189	12,637	131,437
Jun '23	1.73	52.04	118,200	2,271	149,709	0.79	183	201	12,127	130,327
Jul '23	2.07	64.26	108,300	1,685	137,511	0.79	222	231	10,113	118,413
Aug '23	2.02	62.74	120,600	1,922	142,457	0.85	192	201	10,893	131,493
Sep '23	2.53	75.95	105,300	1,386	134,488	0.78	195	213	10,331	115,631
Oct '23	2.16	67.00	104,700	1,563	134,616	0.78	195	201	15,313	120,013
Average	2.63	80.19	121,075	1,577	131,419	0.95	206	217	14,607	135,682

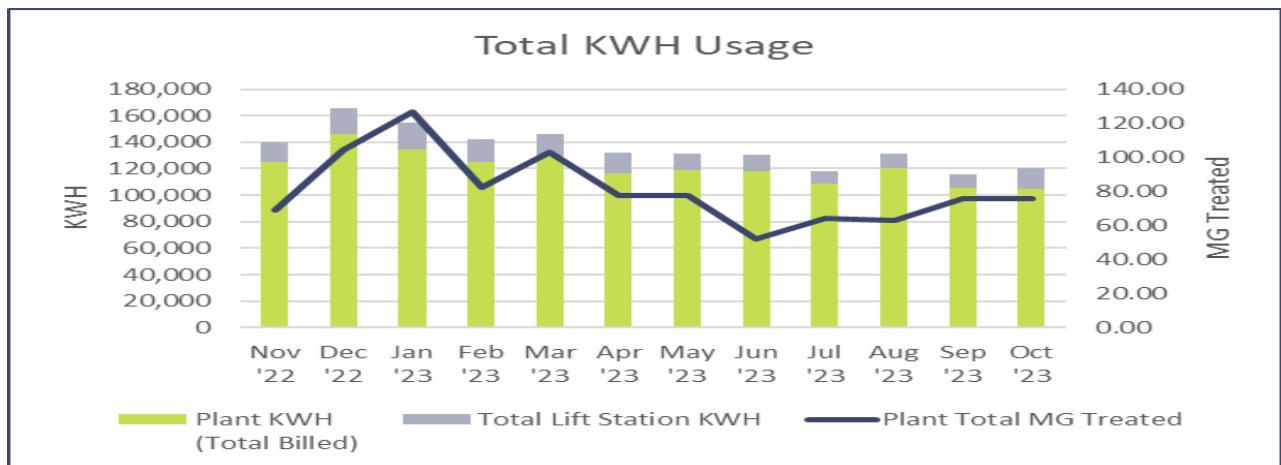

Monthly Lift Station KWH

Month	Hingham North	Hingham South	Spruce	Butternut	Old Country Way	Market	Woodsbury	Lincoln	Forest	Wheeler	Summer	Milbrook	John Burke	Total
Nov'22	2,907	4,600	218	66	1,184	832	1,240	308	2,043	63	67	1,734	207	15,469
Dec'22	3,575	6,100	156	83	1,427	957	1,841	352	2,515	63	63	2,026	263	19,421
Jan'23	3,577	6,500	145	90	1,802	924	1,848	341	2,466	123	62	1,863	308	20,049
Feb'23	3,039	5,000	141	70	1,281	862	1,440	325	2,187	227	59	1,749	332	16,712
Mar'23	2,995	5,100	246	434	1,260	851	1,353	283	1,915	58	67	1,524	236	16,322
Apr'23	3,531	4,100	176	0	1,174	781	1,447	311	2,179	82	65	1,922	125	15,893
May'23	2,373	3,800	114	69	956	695	1,034	201	1,587	57	59	1,459	233	12,637
Jun'23	2,040	4,200	145	62	887	409	1,116	186	1,714	65	63	1,064	176	12,127
Jul'23	1,810	3,600	157	57	897	306	868	156	1,159	56	58	891	98	10,113
Aug'23	2,145	3,400	109	58	911	313	838	163	1,933	59	56	818	90	10,893
Sep'23	1,646	3,400	226	53	911	403	967	188	1,478	56	52	874	77	10,331
Oct'23	2,204	3,700	151	60	1,003	792	1,523	257	1,894	91	61	1,389	172	15,313
Average	2,654	4,458	165	92	1,141	677	1,293	256	1,923	83	61	1,443	193	14,607

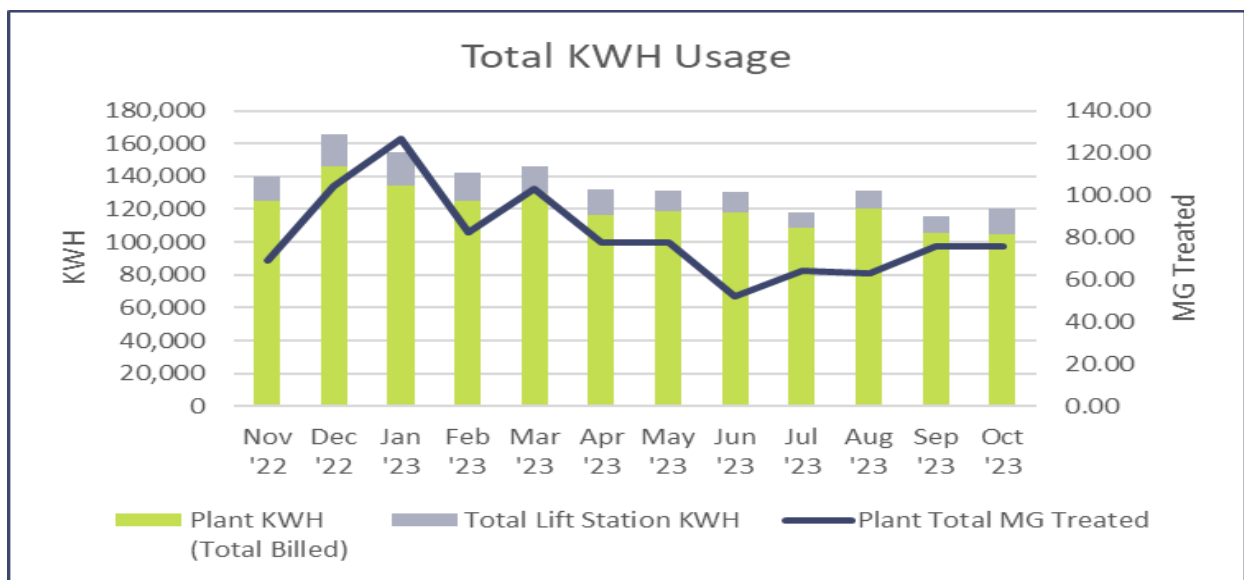

7.0 MAINTENANCE

7.1 WORK ORDER OVERVIEW

WO Type	Total This Month	Total This Year
Preventative Maintenance	170	861
Corrective Maintenance	25	89
Emergency Call Outs Total	7	20

7.2 EMERGENCY CALL OUTS FOR THE MONTH

Type	Total this Month	Total this Year
Sewer Back Up / Collection System	0	2
Pump Station	5	14
Plant	2	2
Odor	0	0
Power Outages	0	1
Total:	7	15

7.3 INSPECTIONS / ANNUAL PMS COMPLETED DURING THE MONTH

1. All pump station alarms checked
2. Spruce probe cleaned weekly
3. Eye wash inspections completed weekly
4. Fire extinguisher inspections completed monthly
5. Dependable Petroleum monthly UST Inspection
6. Appollo Safety Quarterly Inspection


7.4 COLLECTION SYSTEM AND IPP ASSISTANCE PERFORMED BY VEOLIA

COLLECTION SYSTEM ASSISTANCE:

Type	Total This Month	Total This Year
Sewer Inspection / Tie-Ins	0	0
Sewer Location mark Outs	39	338
Sewer Back Up	0	1

7.5 WORK ORDER STATISTICS

There were 152.82 total reported maintenance hours during the month. Of this total, outside contractors accounted for 43% with **65** hours recorded.

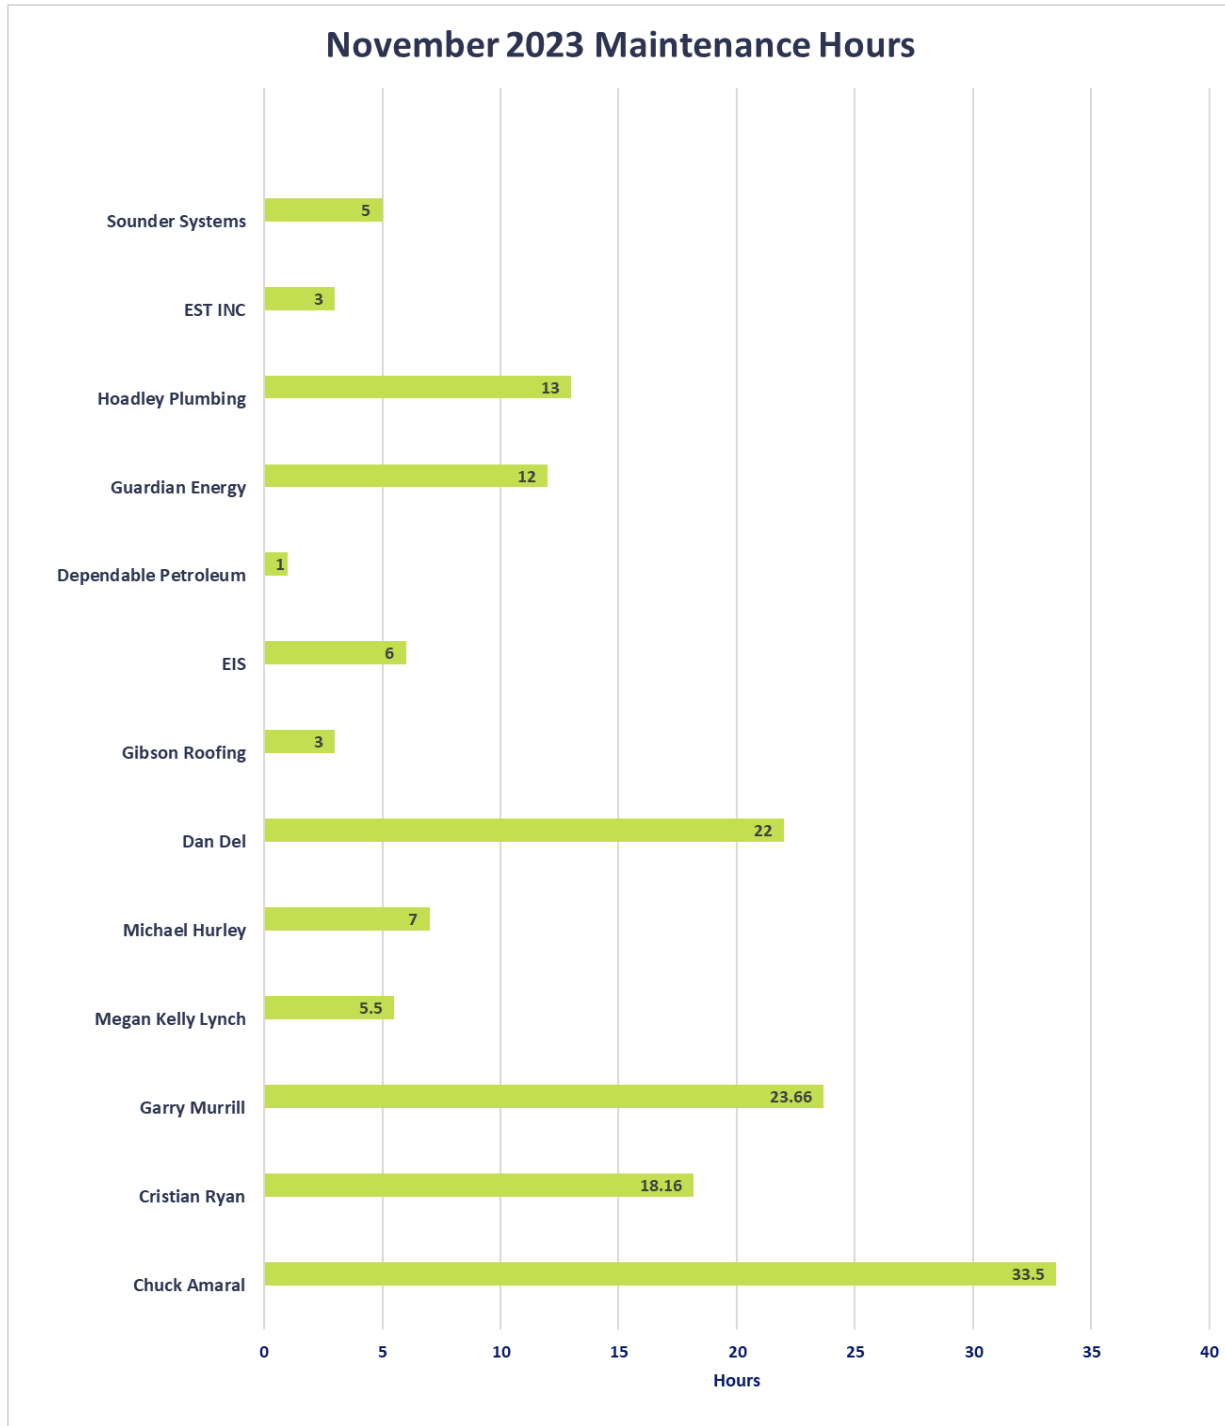

8.0 FINANCIAL ACCOUNTING- REPAIR / MAINTENANCE (JULY '23 – JUNE '24)

Item	Budget	Spent Month	Spent Year	Remaining
R & M (Project)	\$100,000.00	\$8,105.64	\$44,780.27	\$55,219.73

8.1 SIGNIFICANT R&M PURCHASES

1. EIS Troubleshoot and Reprogrammed Hingham St. North and Hingham St. South \$1,230.00
2. Renew Mechanical installed new lime pump \$1,795.00
3. ESI connected the Chlorine Sensor to SCADA \$1291.50

9.0 ATTACHED REPORTS

- Discharge Monitoring Report
- HACH Wims Data Reports
- Cumulative and Monthly Violation Reports
- Financial Reports
- Solids Removal Summary